


# San Jacinto River Tidal

Station: 11193 Segment: 1001 Parameter: Enterococci

Assessment Unit: 1001\_02

2010 Water Quality Standard: 35 MPN / 100 mL

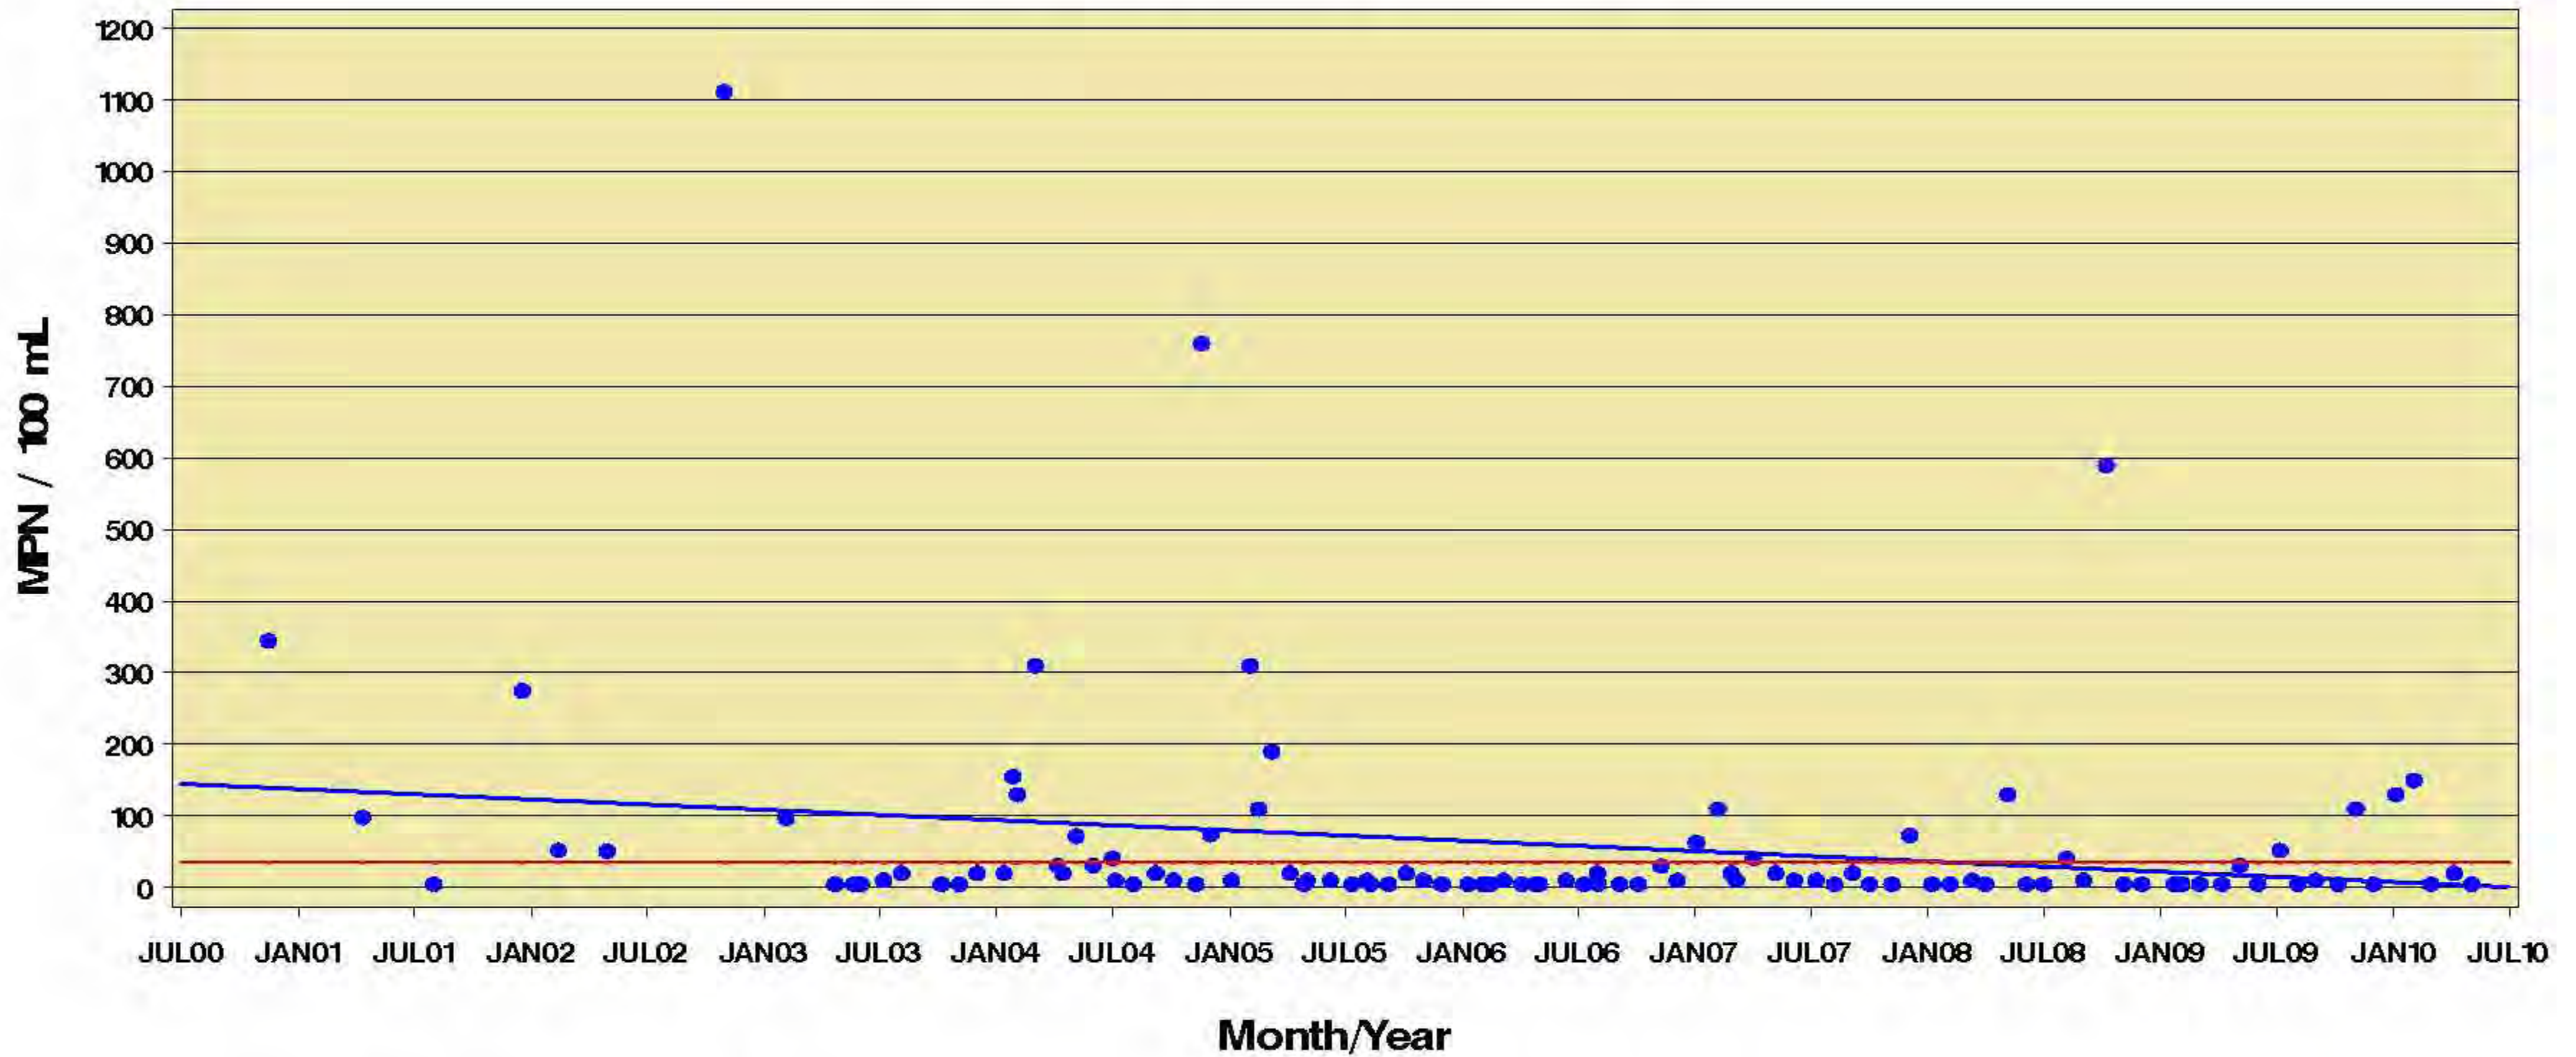

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.0254 R-Square= 0.0476 T-Value= -2.2680 Number of Samples= 105

Red line indicates the applicable 2010 Water Quality Standard