


San Jacinto River Tidal

Station: 11200 Segment: 1001 Parameter: Enterococci

Assessment Unit: 1001_01

2010 Water Quality Standard: 35 MPN / 100 mL

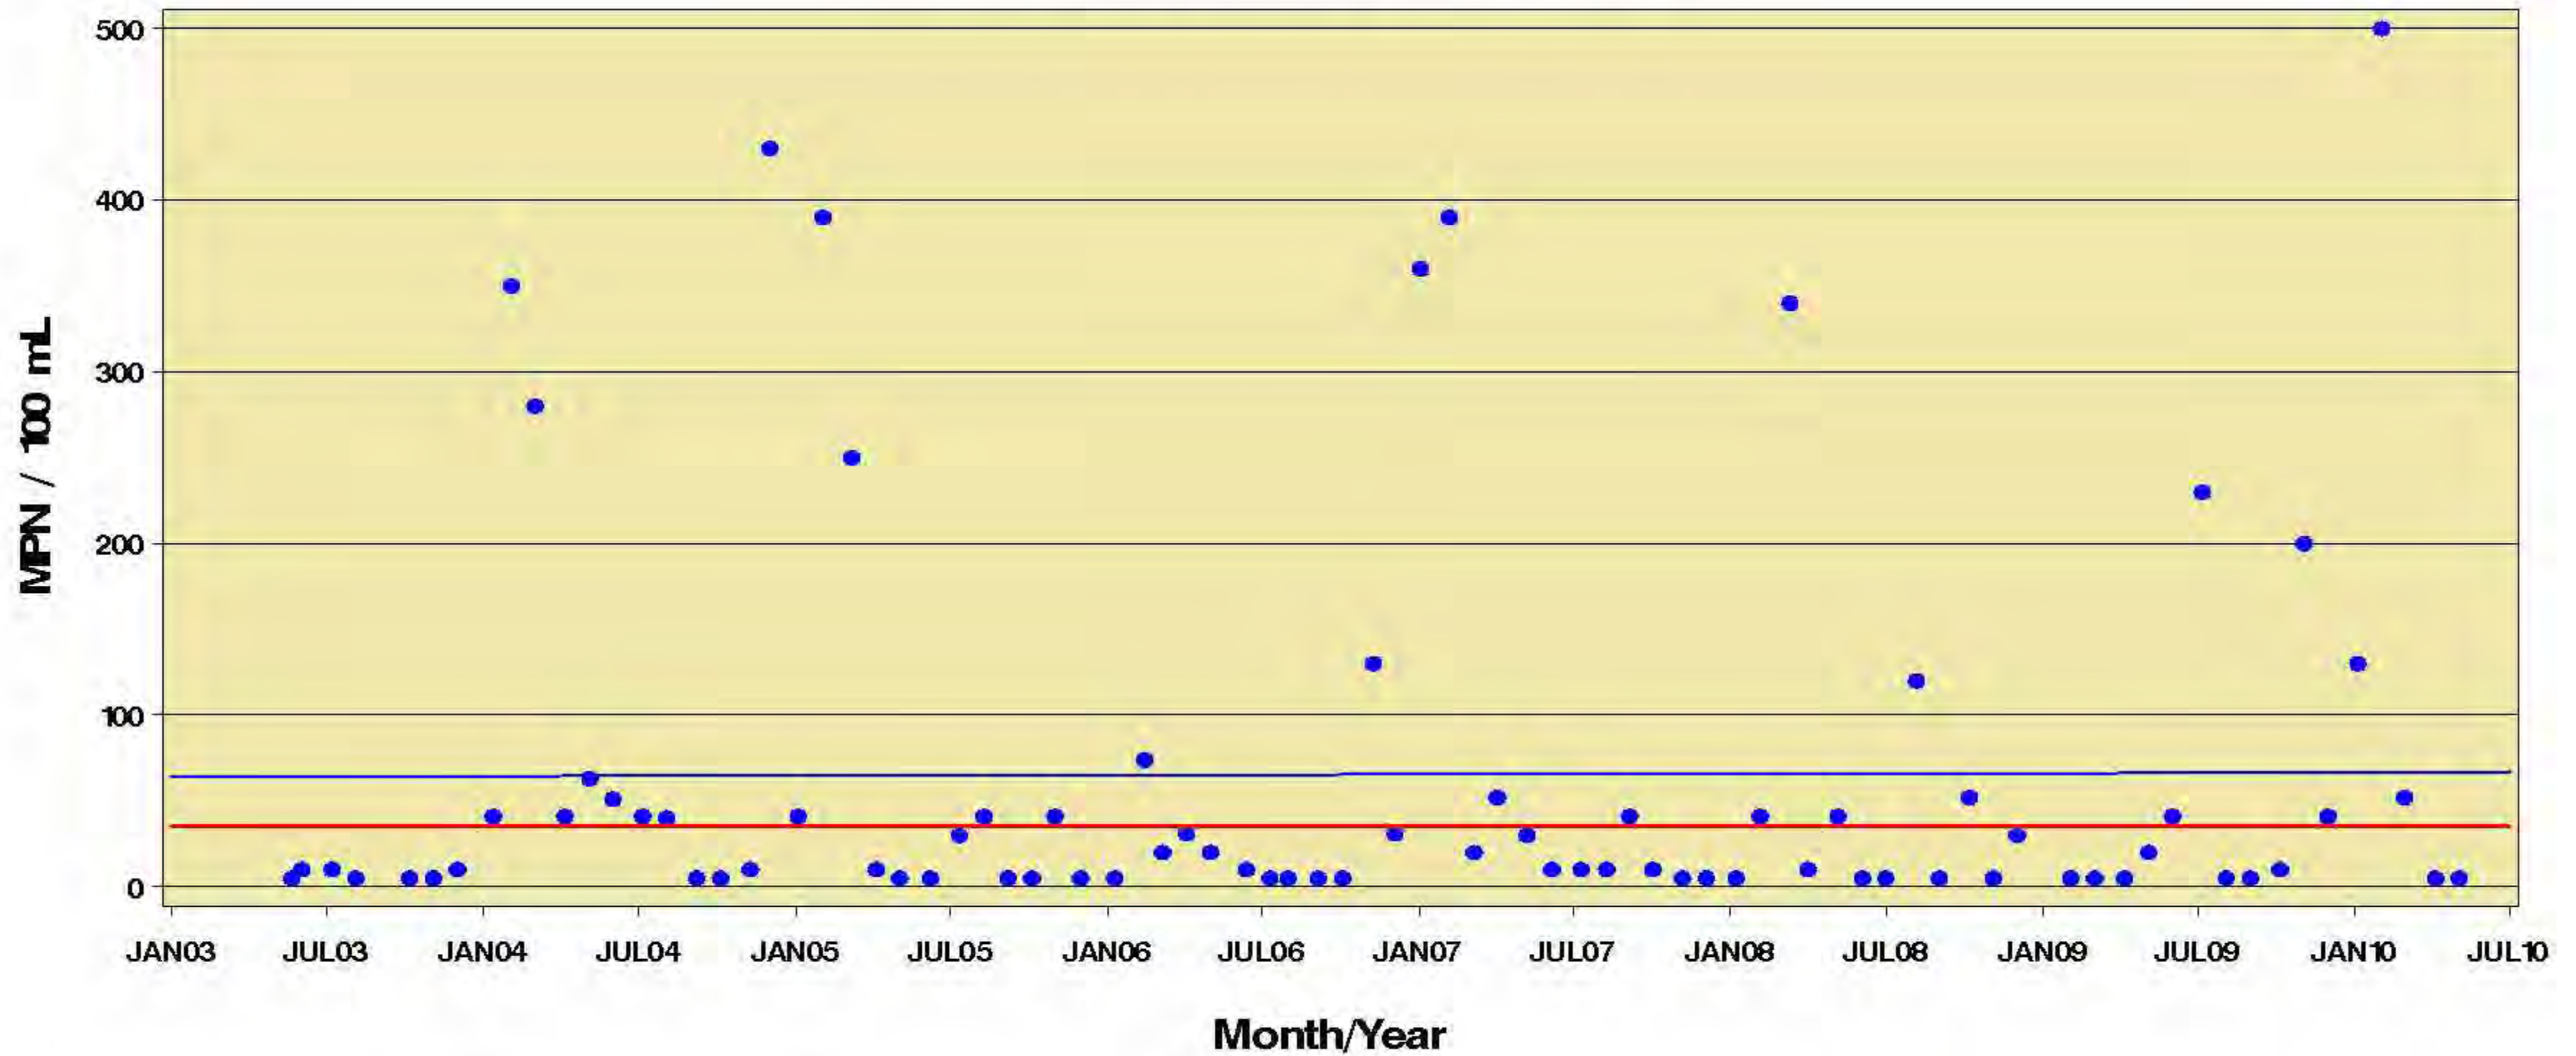

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.9453 R-Square= 0.0001 T-Value= 0.0690

Number of Samples= 83

Red line indicates the applicable 2010 Water Quality Standard