


San Jacinto River Tidal

Monitoring Station: 11193 Segment: 1001 Assessment Unit: 1001_02

Parameter: Enterococci Annual Geometric Mean

2010 Water Quality Standard: 35 MPN / 100 mL

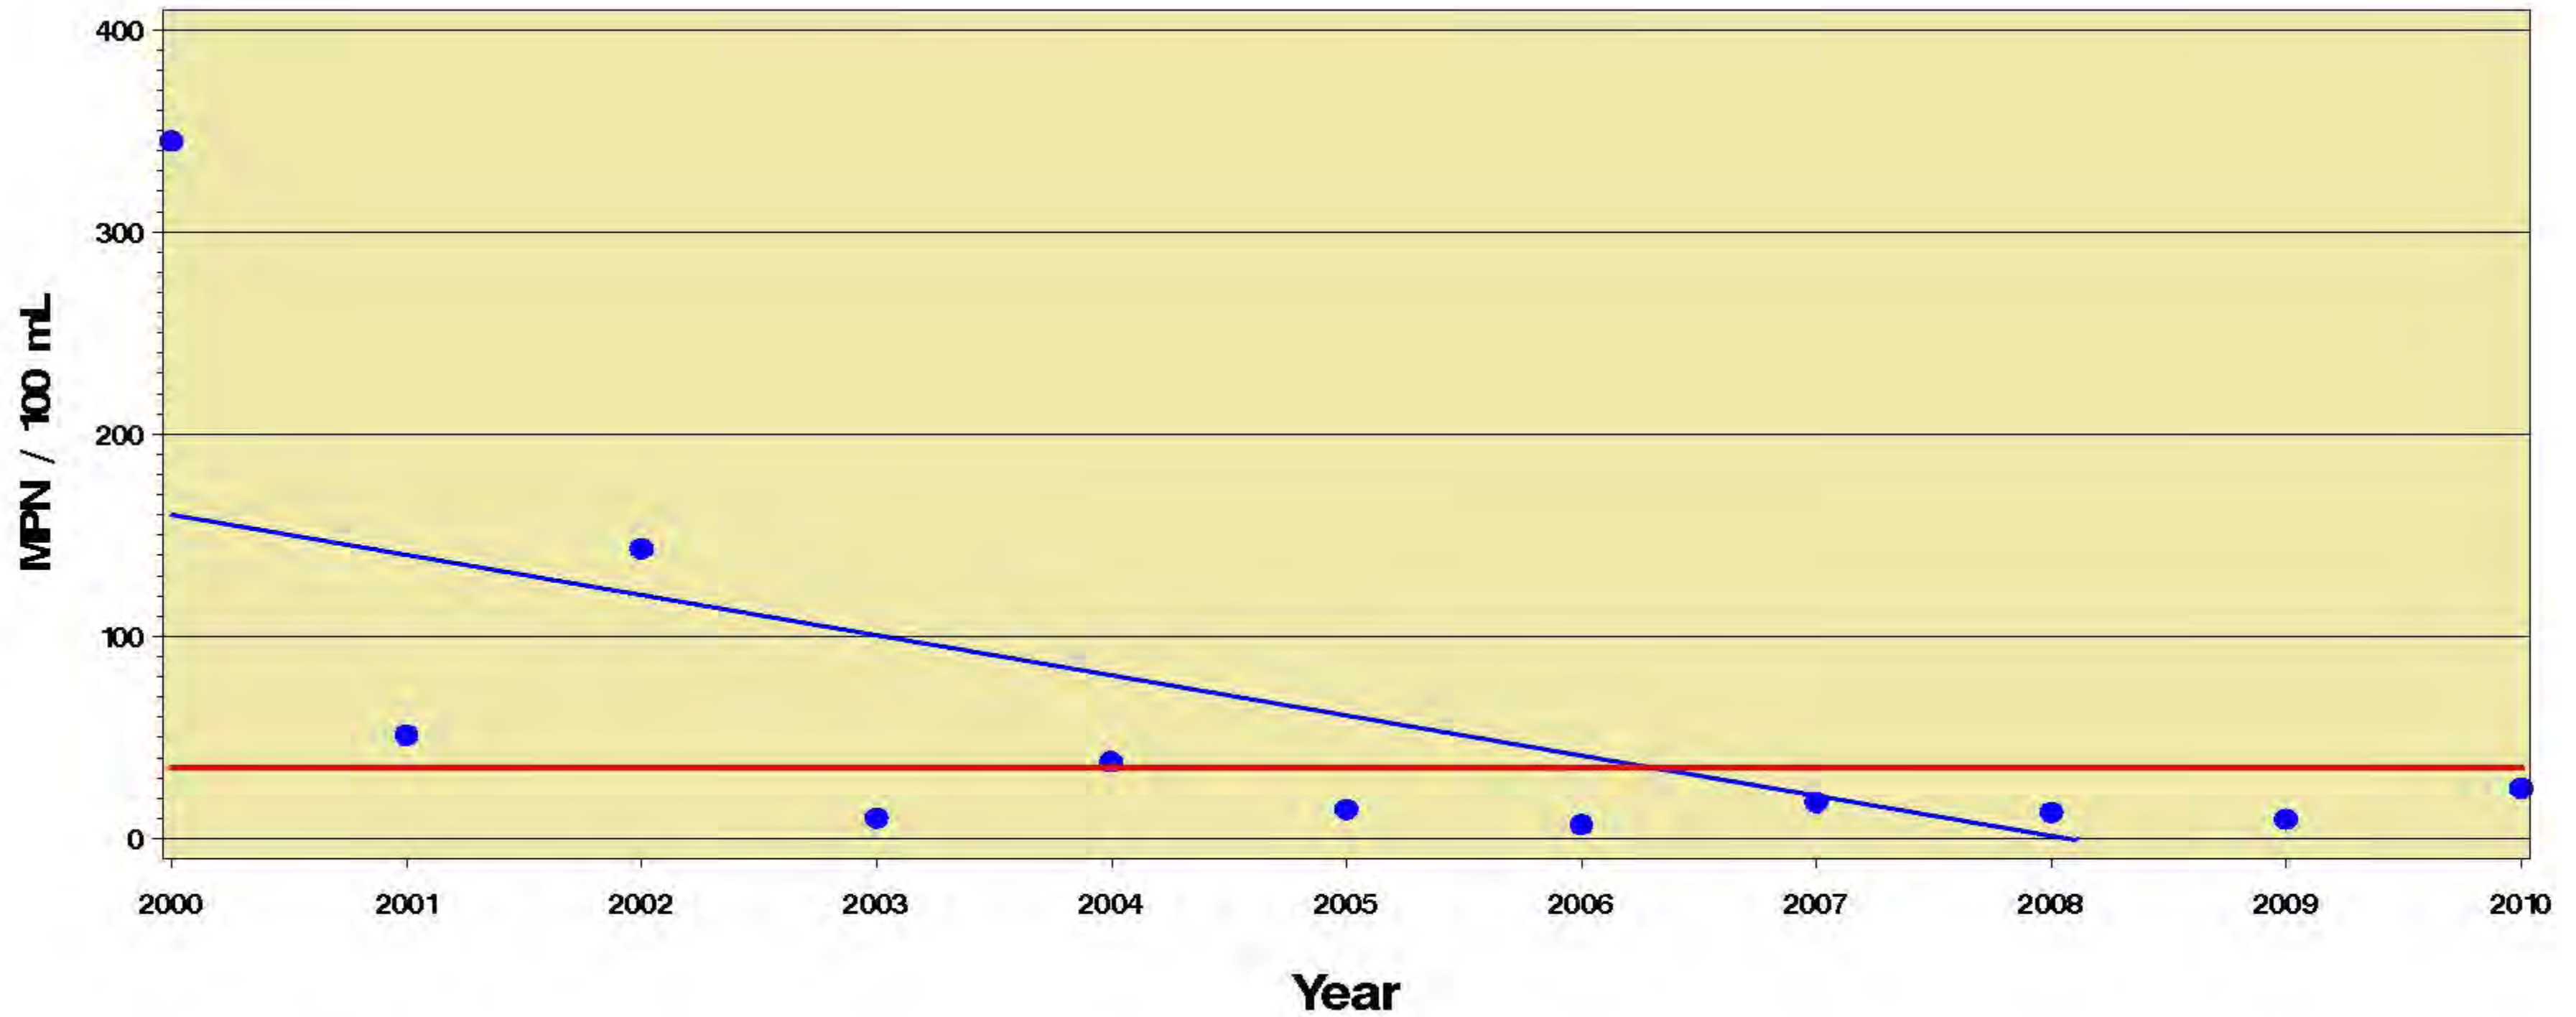

Trends are considered significant if the p-value is < 0.10

Trend is significant at $p = 0.0328$ R-Square = 0.4136 T-Value = -2.519 Number of Samples = 105

Red line indicates the applicable 2010 Water Quality Standard