

Tabbs Bay


Station: 13338

Segment: 2426

Parameter: Enterococci

Assessment Unit: 2426_01

2010 Water Quality Standard: 35 MPN / 100 mL

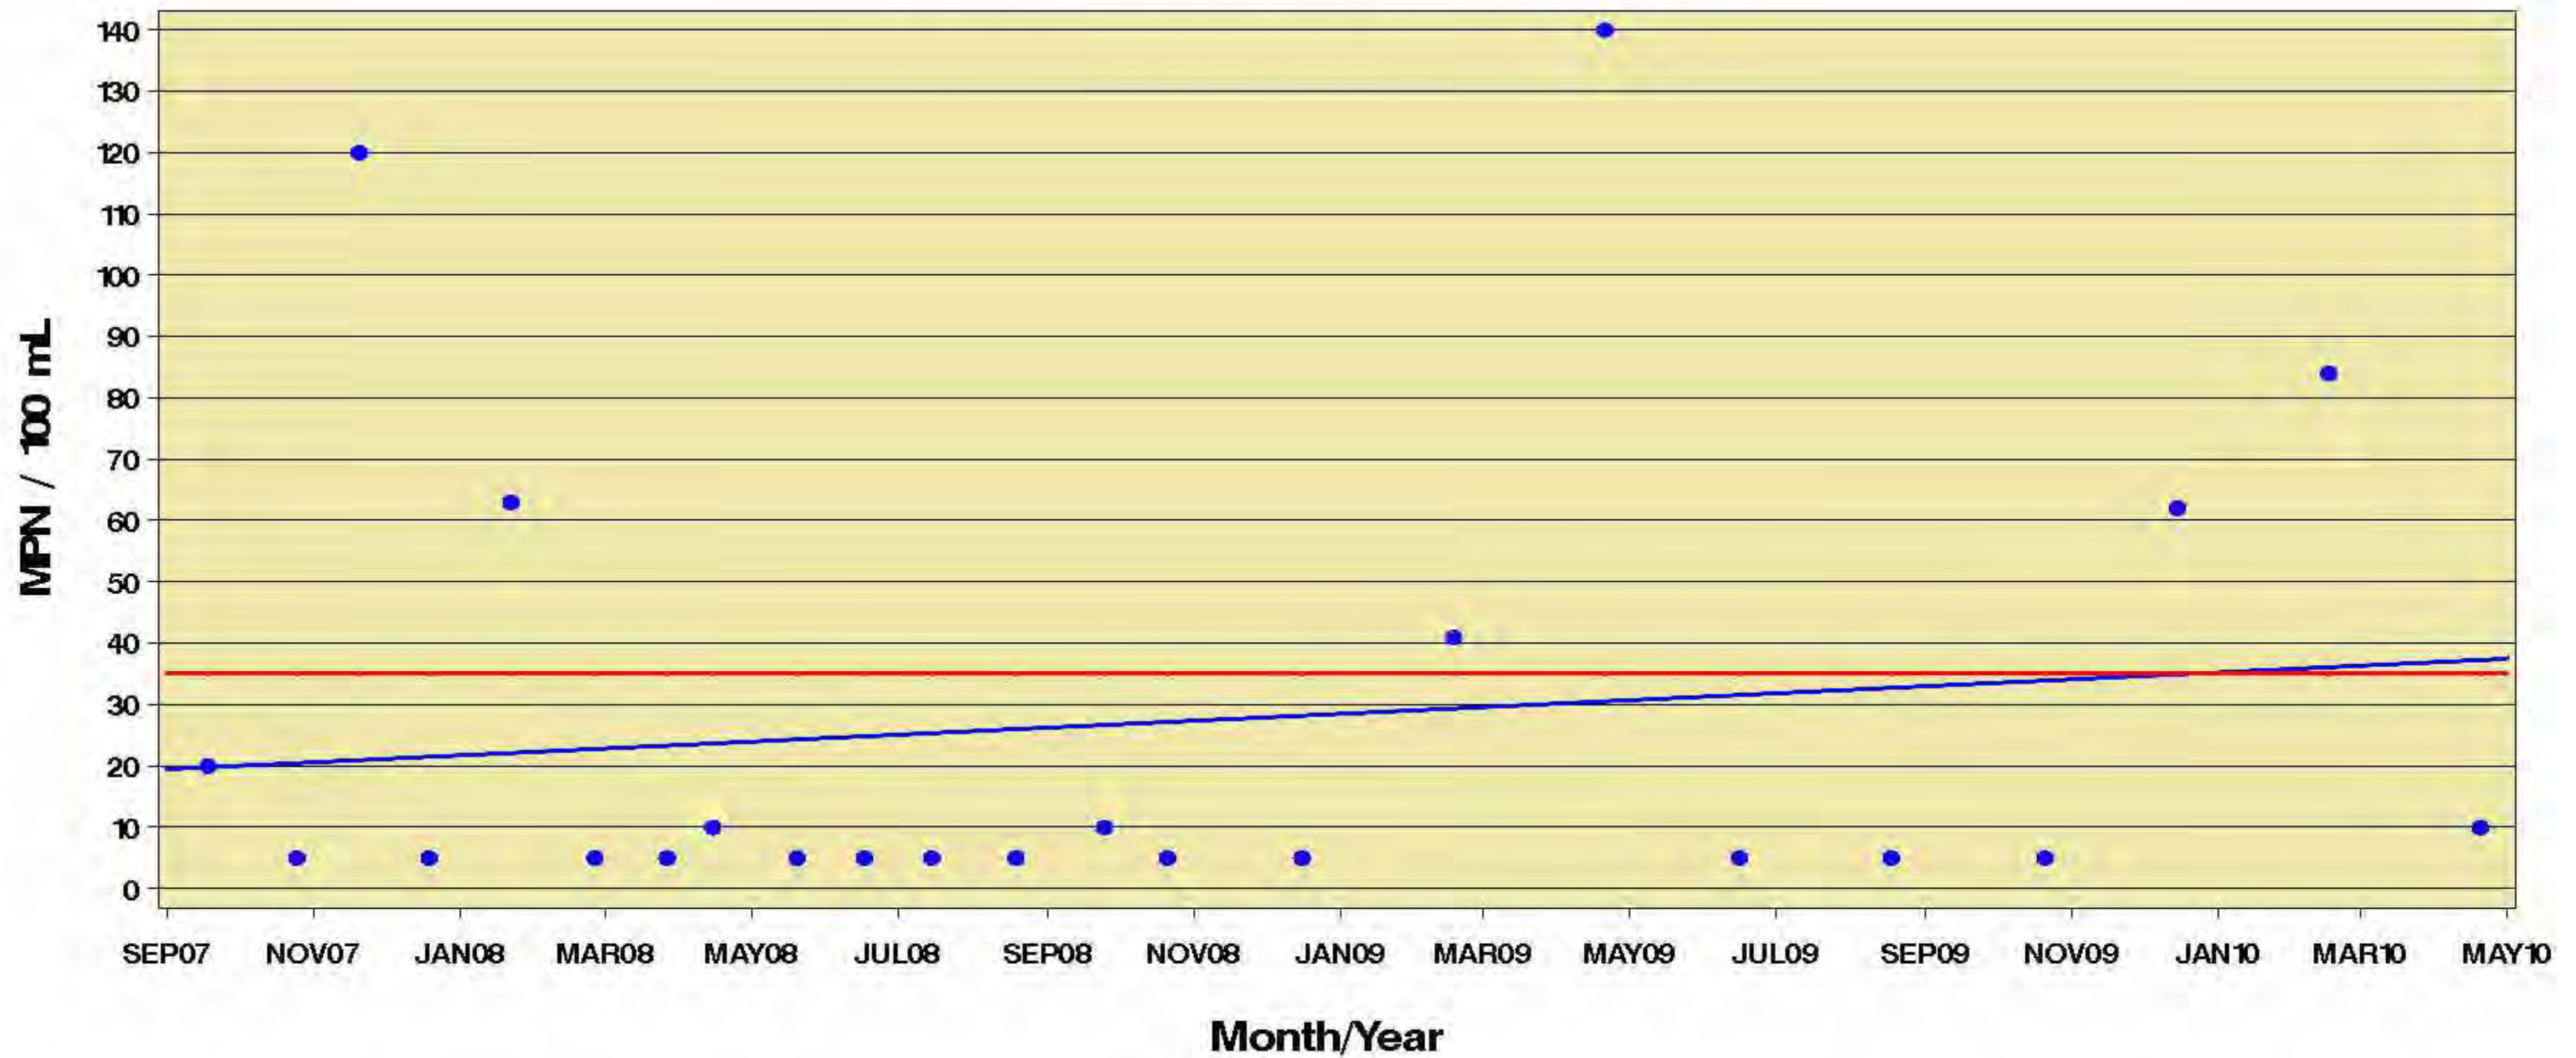

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.5392 R-Square= 0.0182 T-Value= 0.6240

Number of Samples= 23

Red line indicates the applicable 2010 Water Quality Standard