

Tabbs Bay


Station: 13338

Segment: 2426

Parameter: Orthophosphate—P

Assessment Unit: 2426_01

2010 Nutrient Screening Level: 0.19 Mg / L

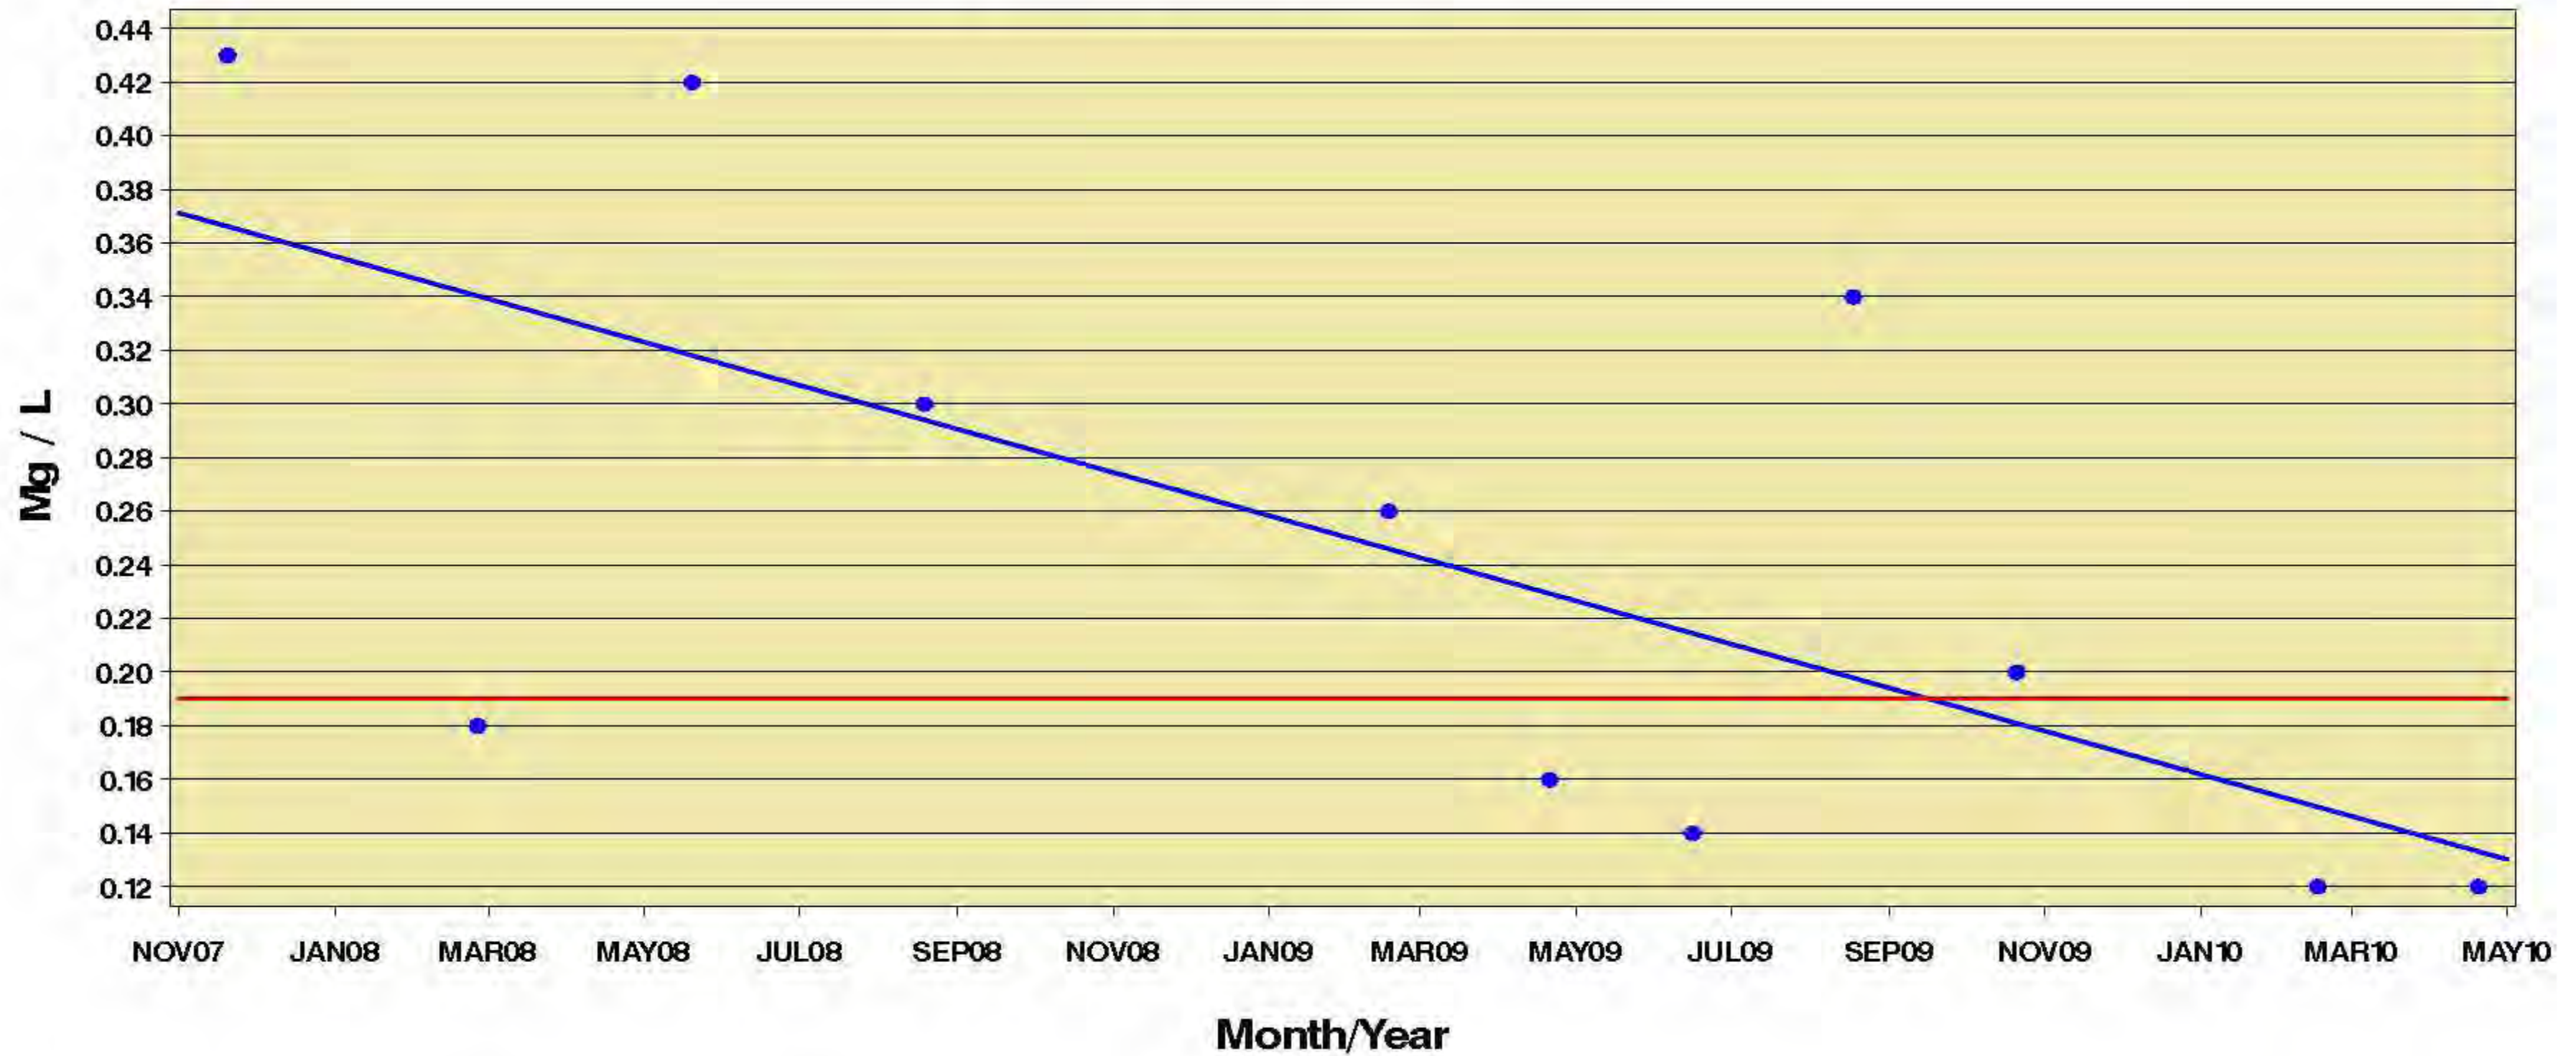

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.0228

R-Square= 0.4552

T-Value= -2.7420

Number of Samples= 11

Red line indicates the applicable 2010 Nutrient Screening Level