


# Tabbs Bay

Station: 13338

Segment: 2426

Parameter: Salinity

Assessment Unit: 2426\_01

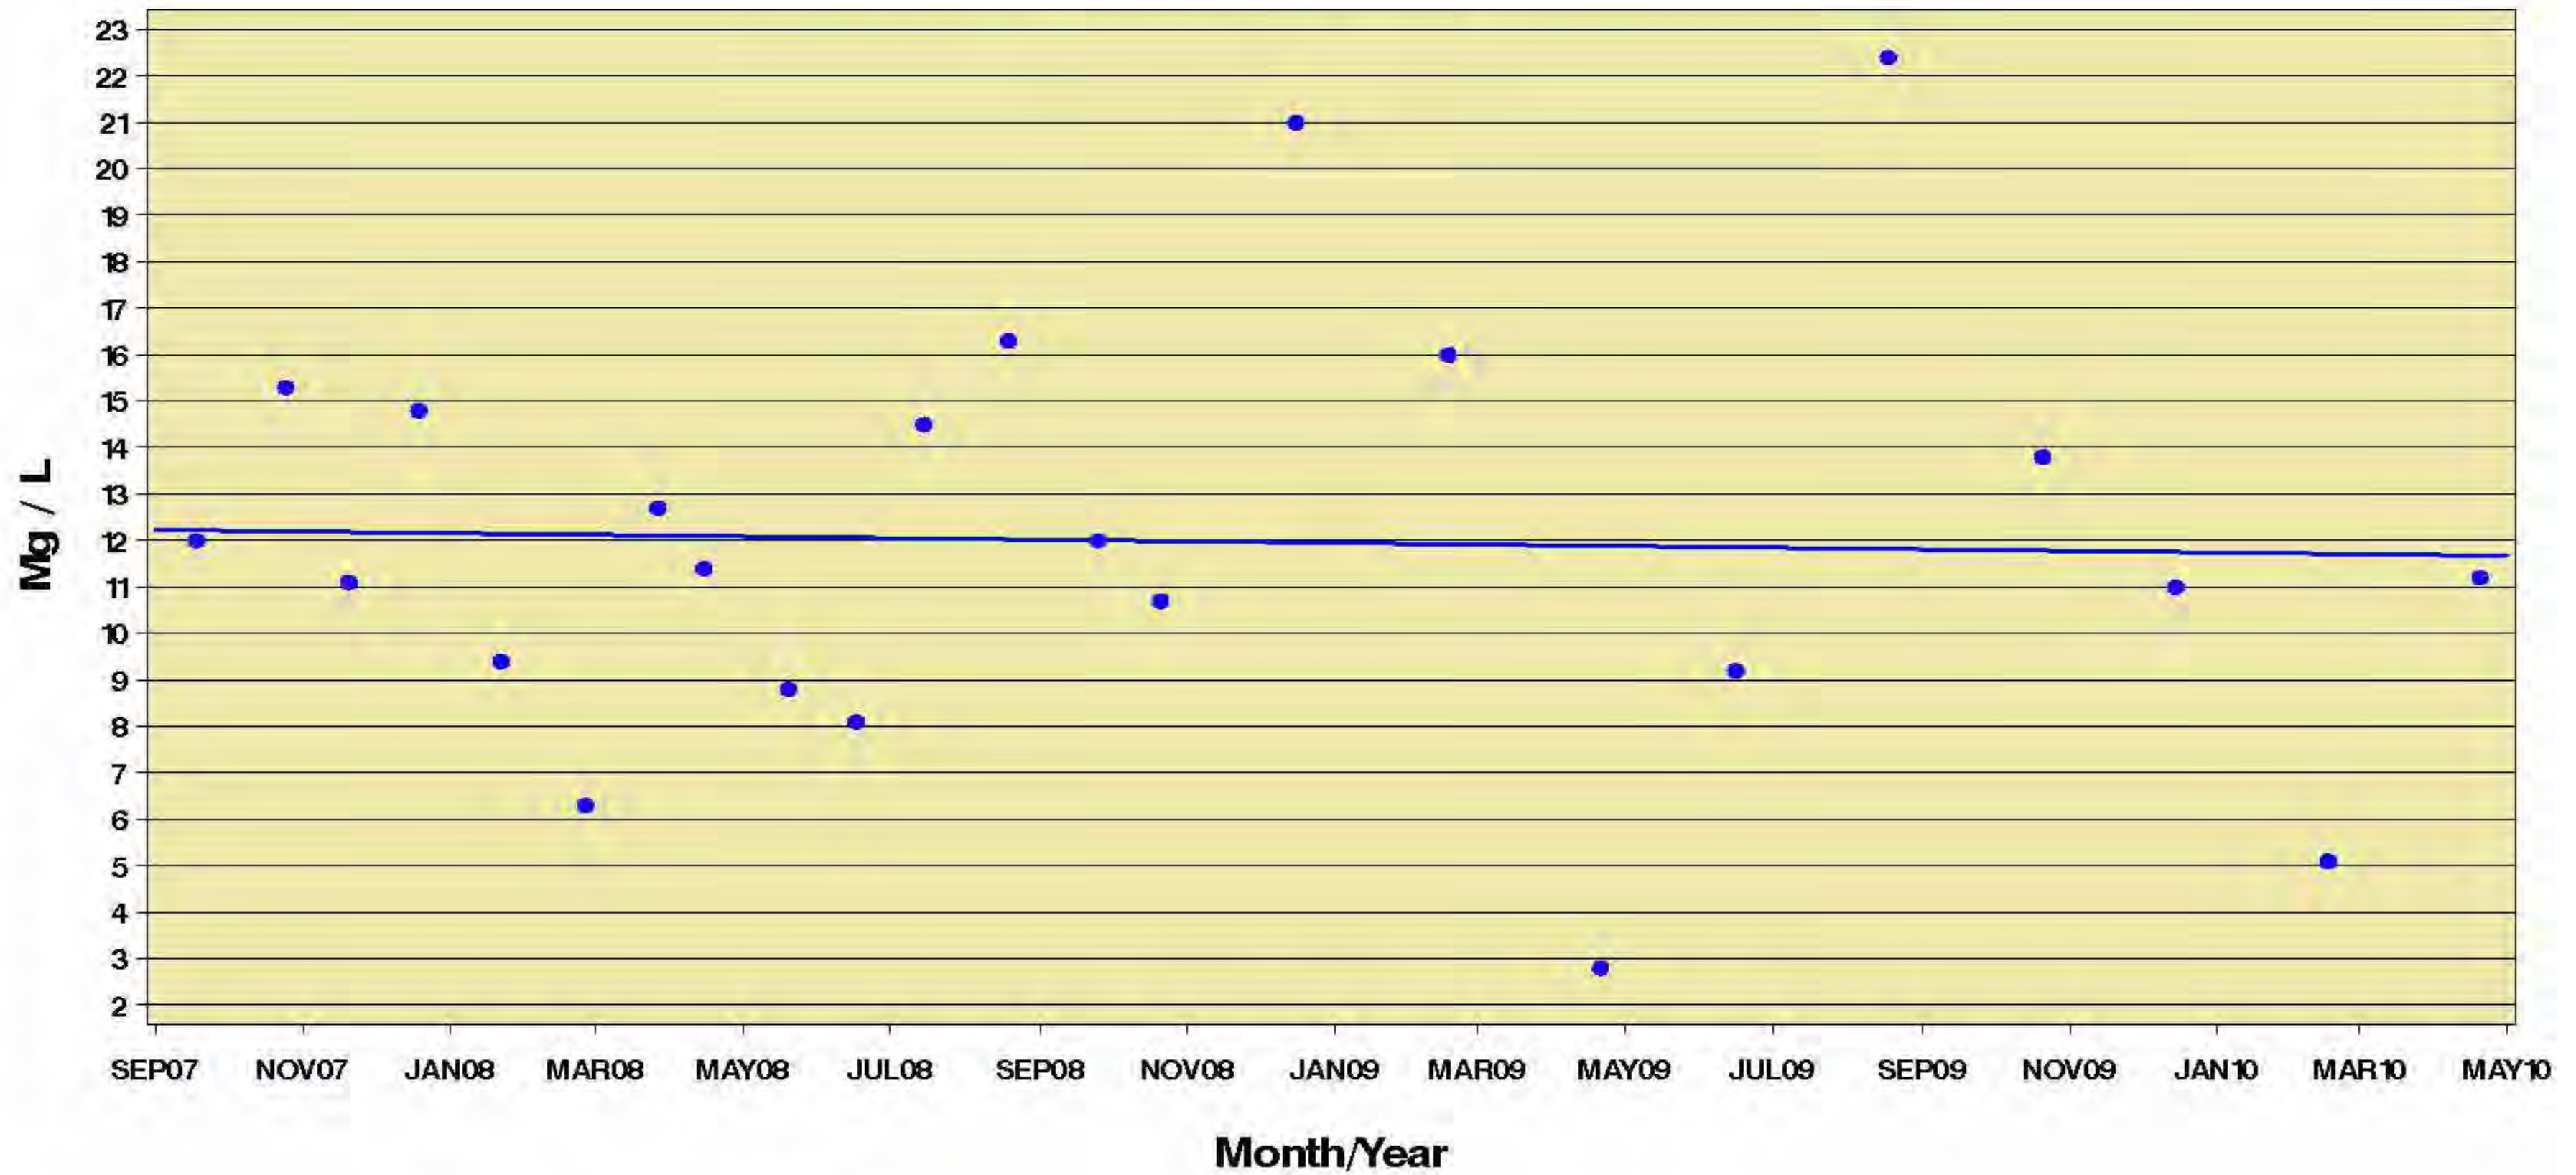

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.8736

R-Square= 0.0012

T-Value= -0.1610

Number of Samples= 23