


Tabbs Bay

Station: 13338

Segment: 2426

Parameter: Total Dissolved Solids

Assessment Unit: 2426_01

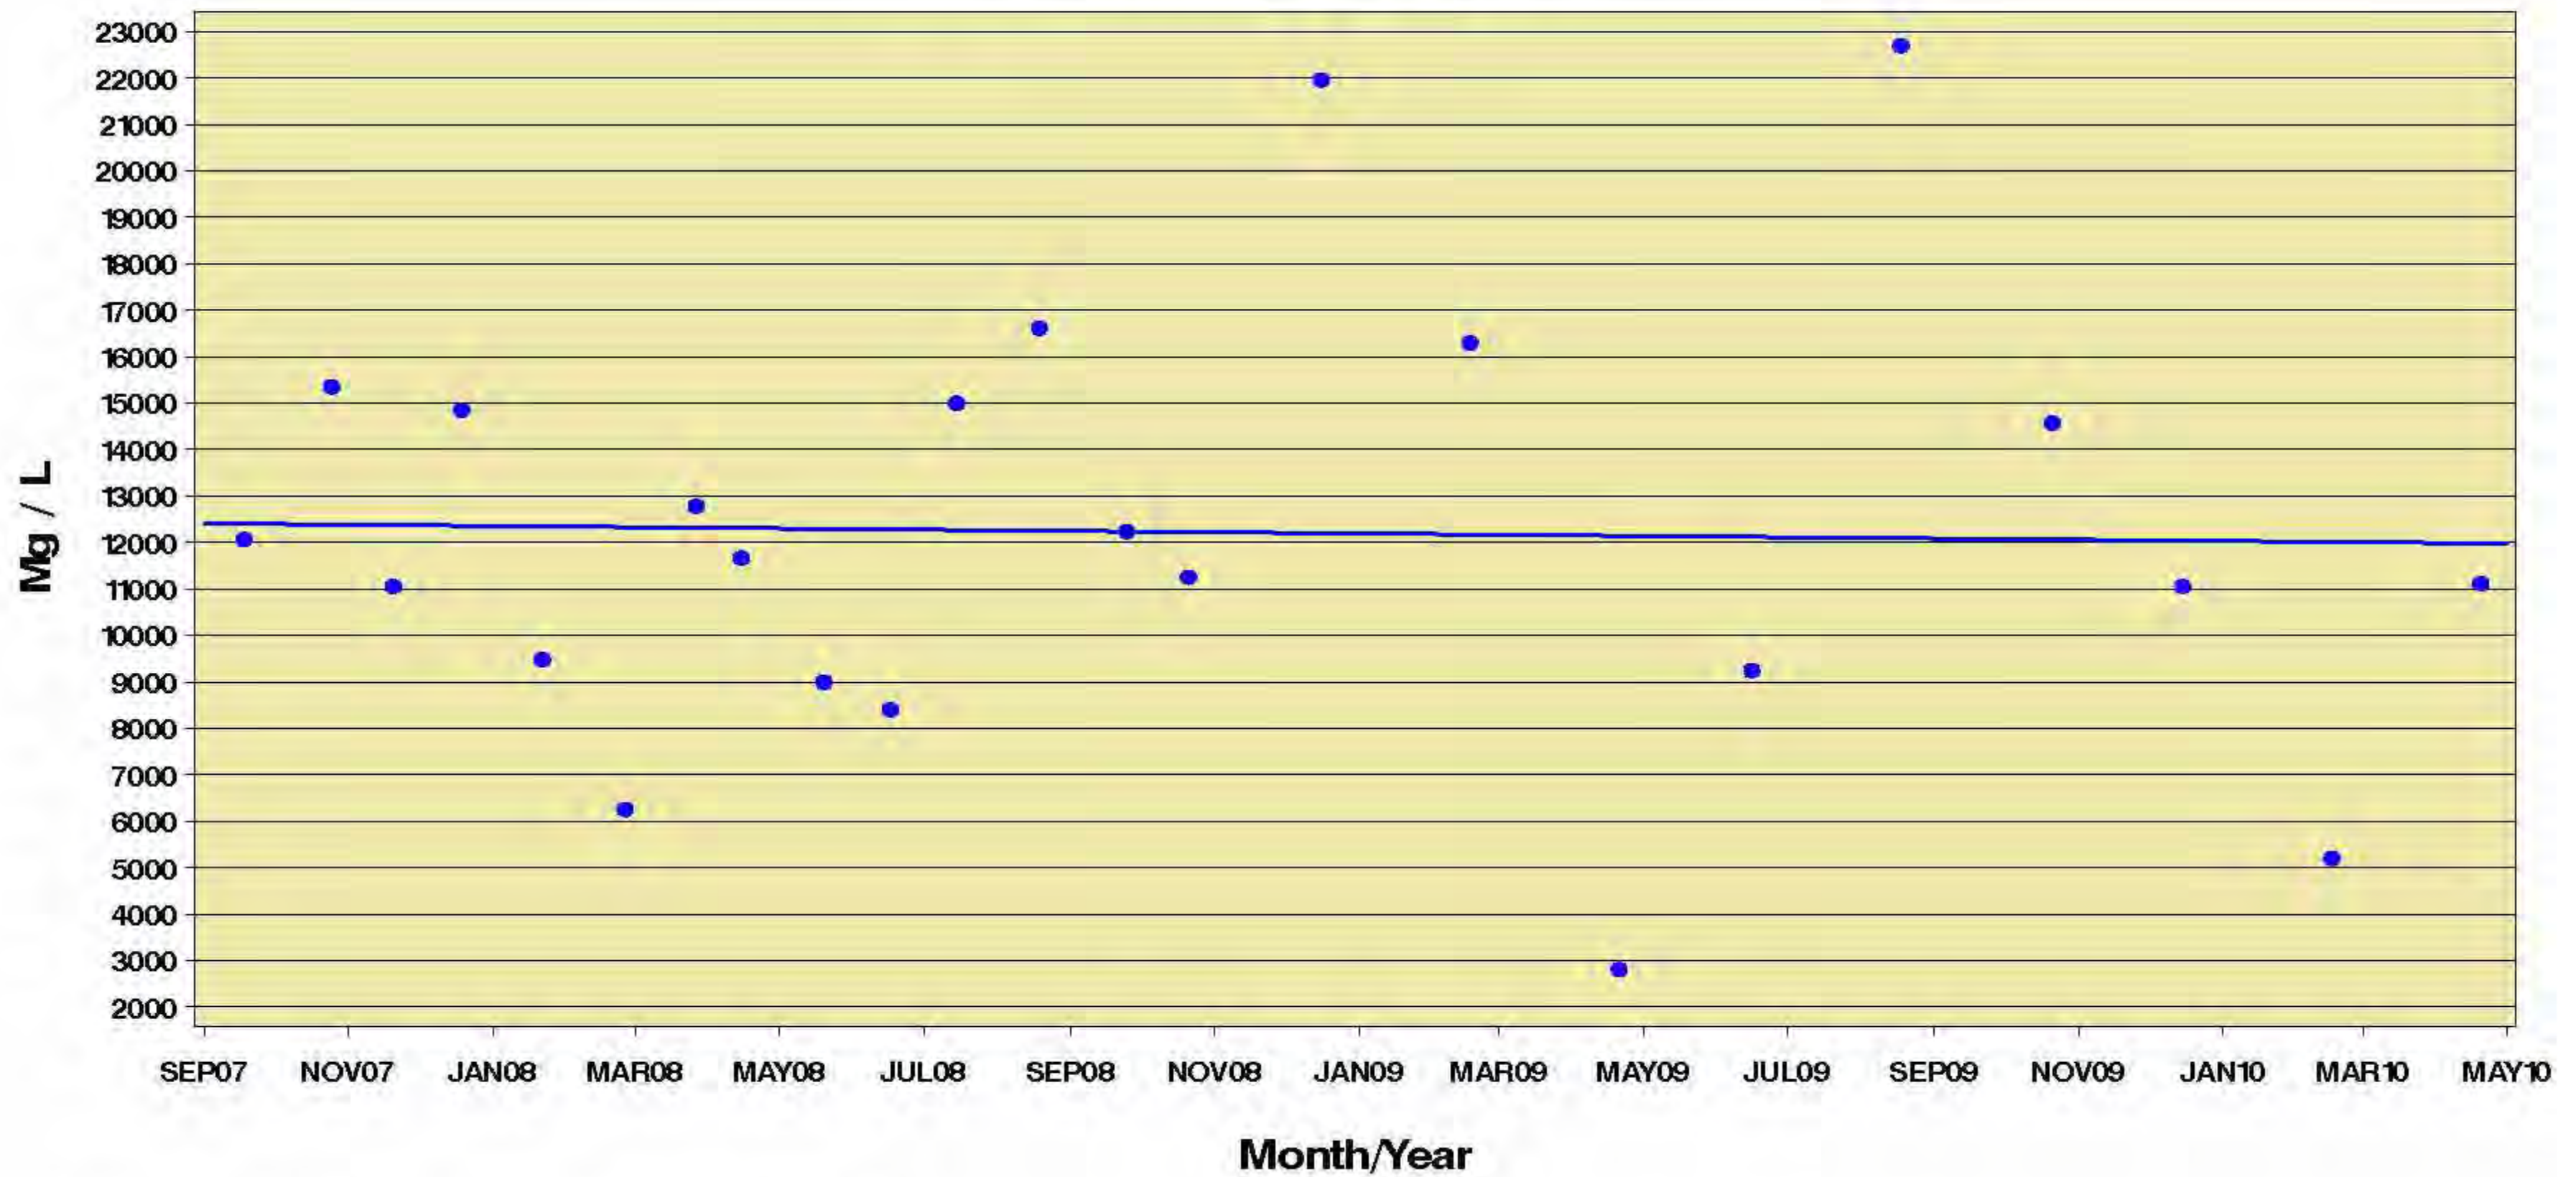

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.9067

R-Square= 0.0007

T-Value= -0.1190

Number of Samples= 23