


Tabbs Bay

Station: 13338

Segment: 2426

Parameter: Total Hardness

Assessment Unit: 2426_01

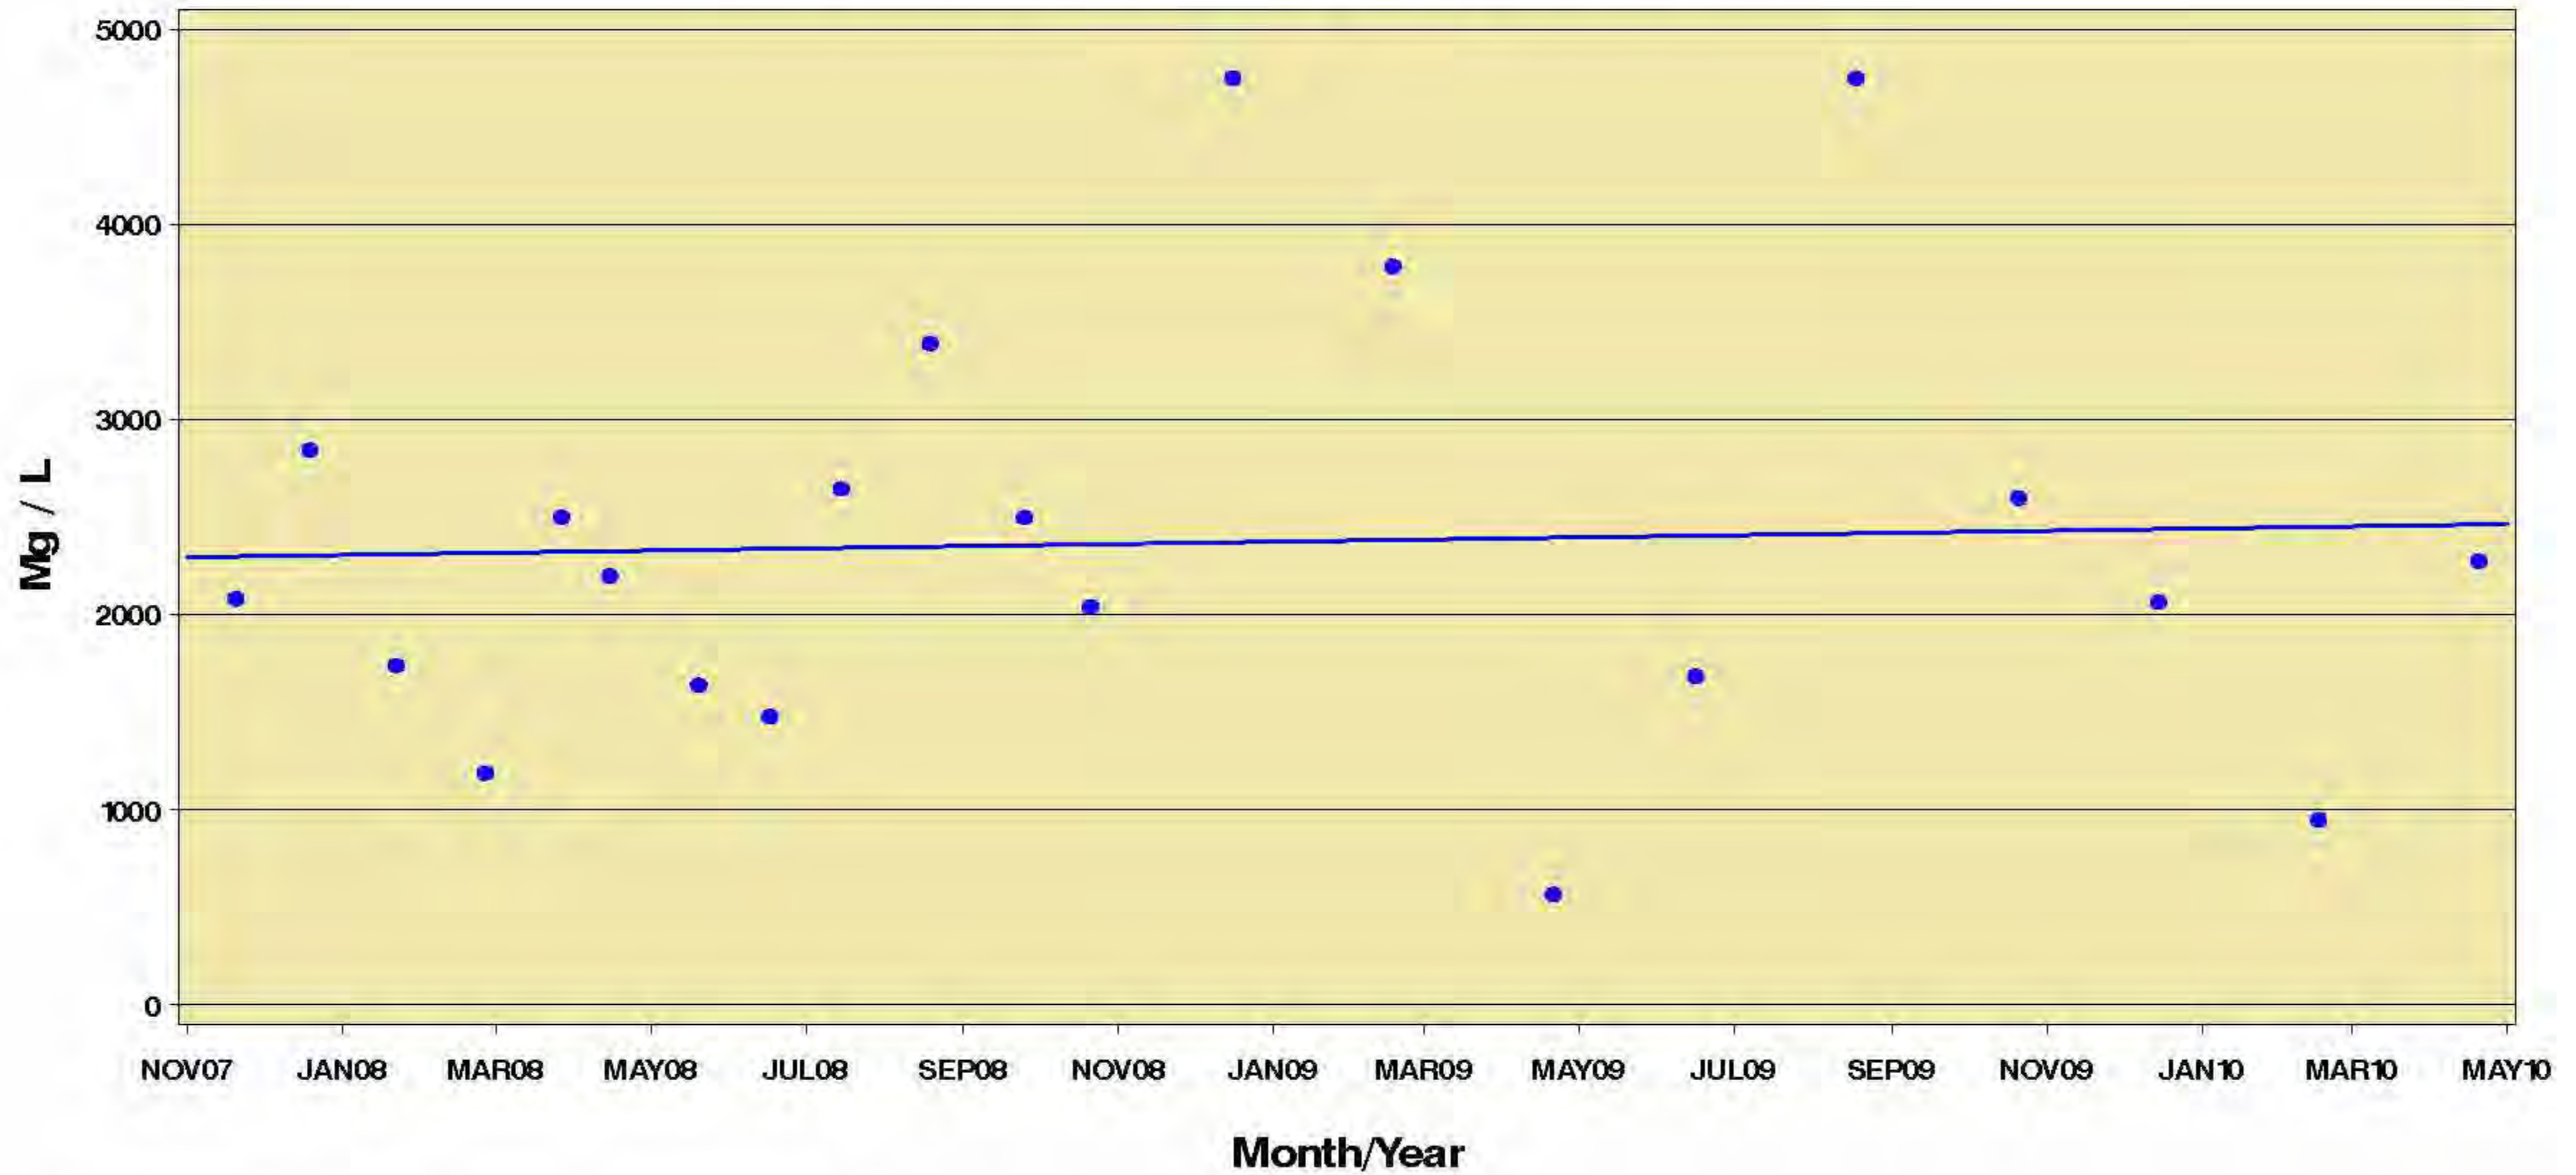

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.8358

R-Square= 0.0023

T-Value= 0.2100

Number of Samples= 21