


Tabbs Bay

Station: T7926 Segment: 2426 Parameter: Nitrate-N

Assessment Unit: 2426_01

2010 Nutrient Screening Level: 0.17 Mg / L

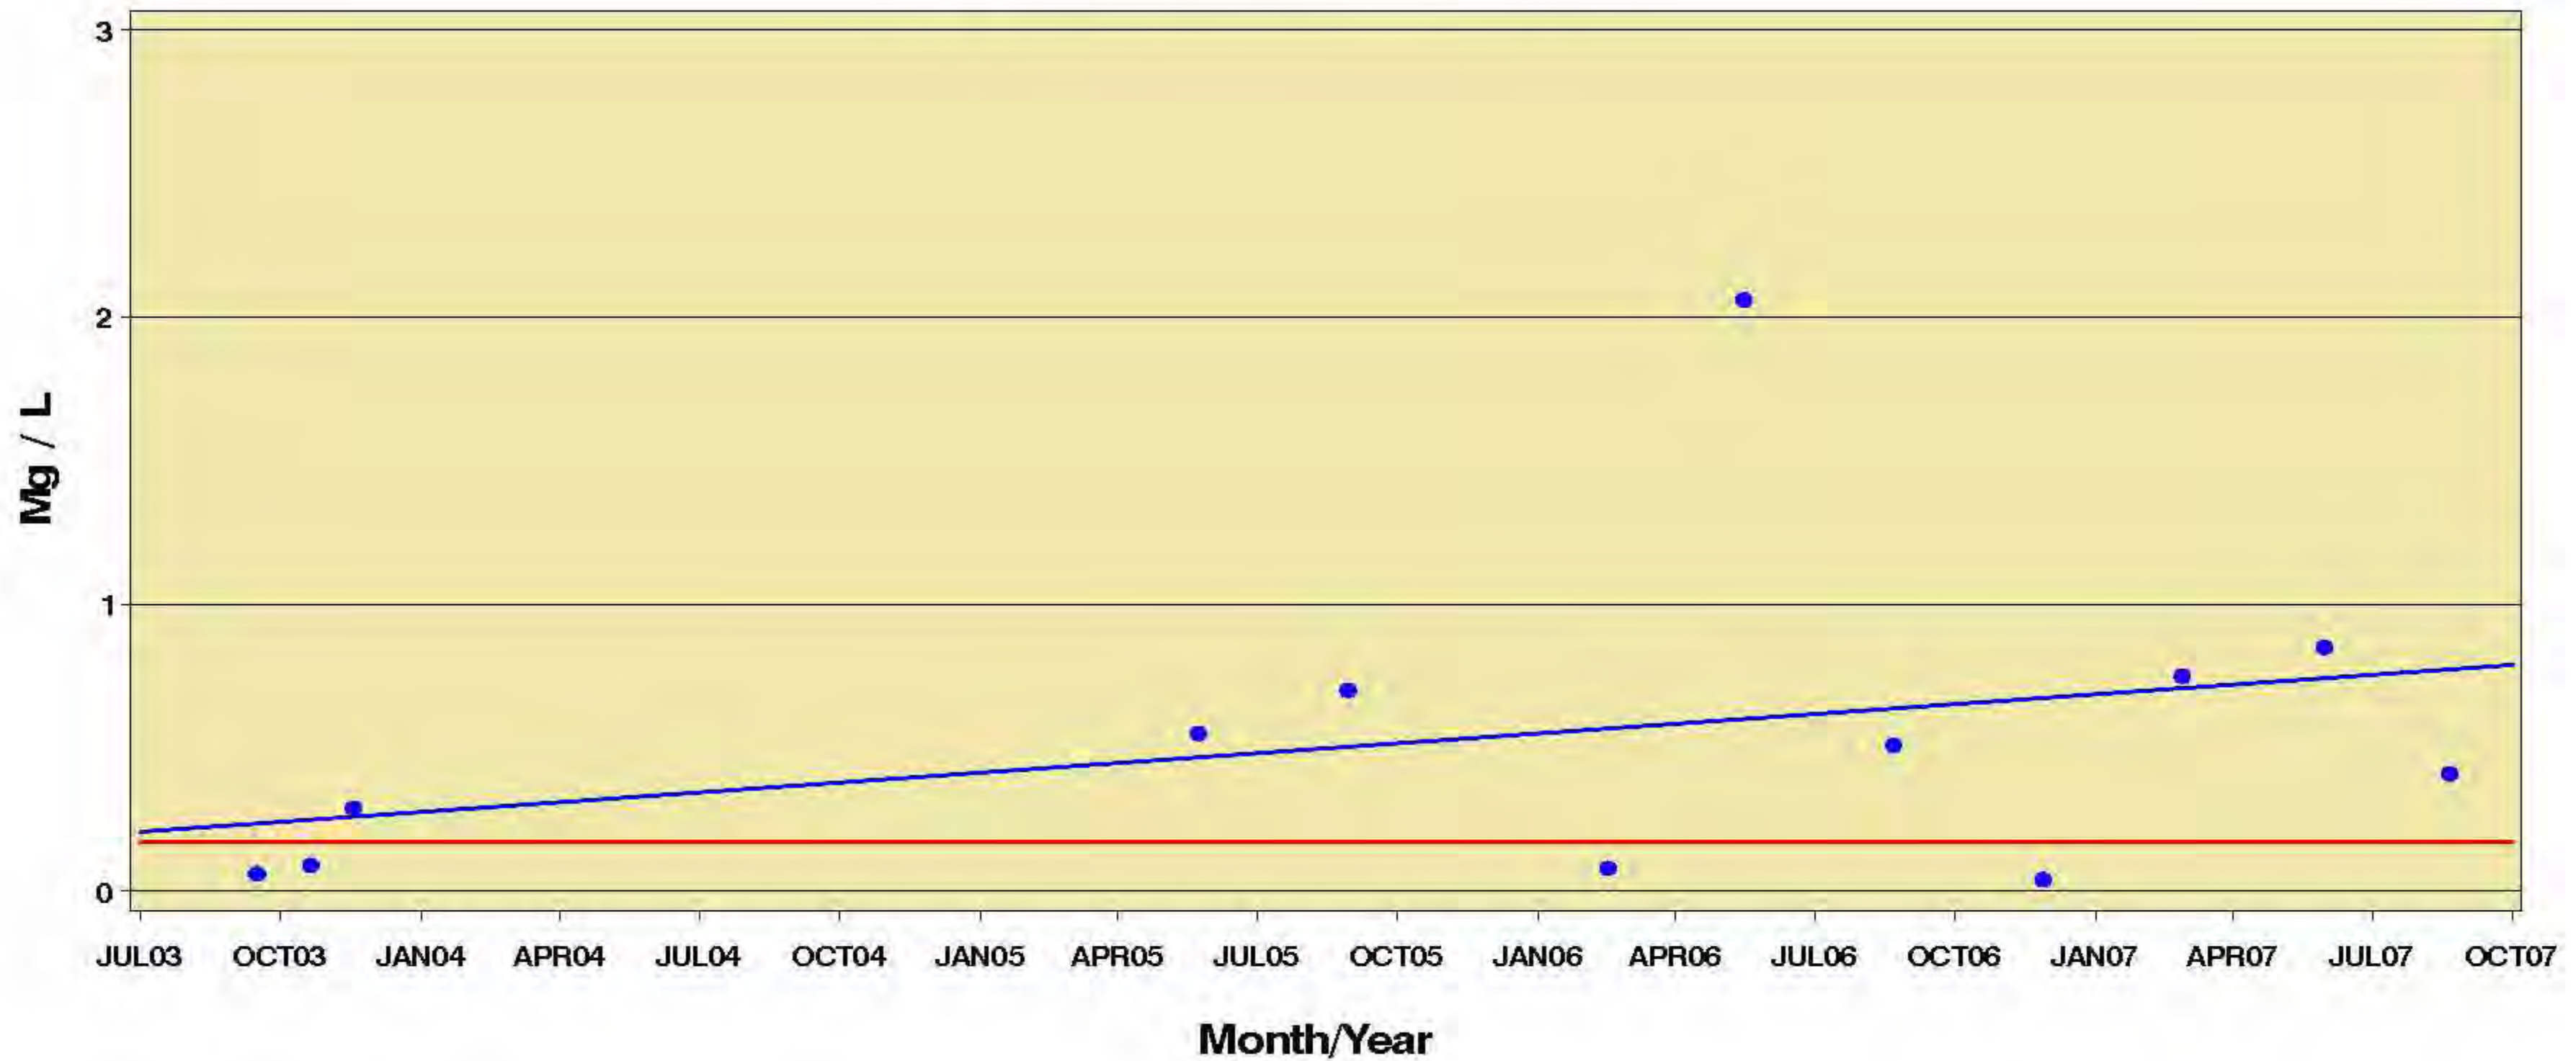

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.2683 R-Square= 0.1208 T-Value= 1.1720 Number of Samples= 12

Red line indicates the applicable 2010 Nutrient Screening Level