

Tabbs Bay


Station: 17926

Segment: 2426

Parameter: Orthophosphate—P

Assessment Unit: 2426_01

2010 Nutrient Screening Level: 0.19 Mg / L

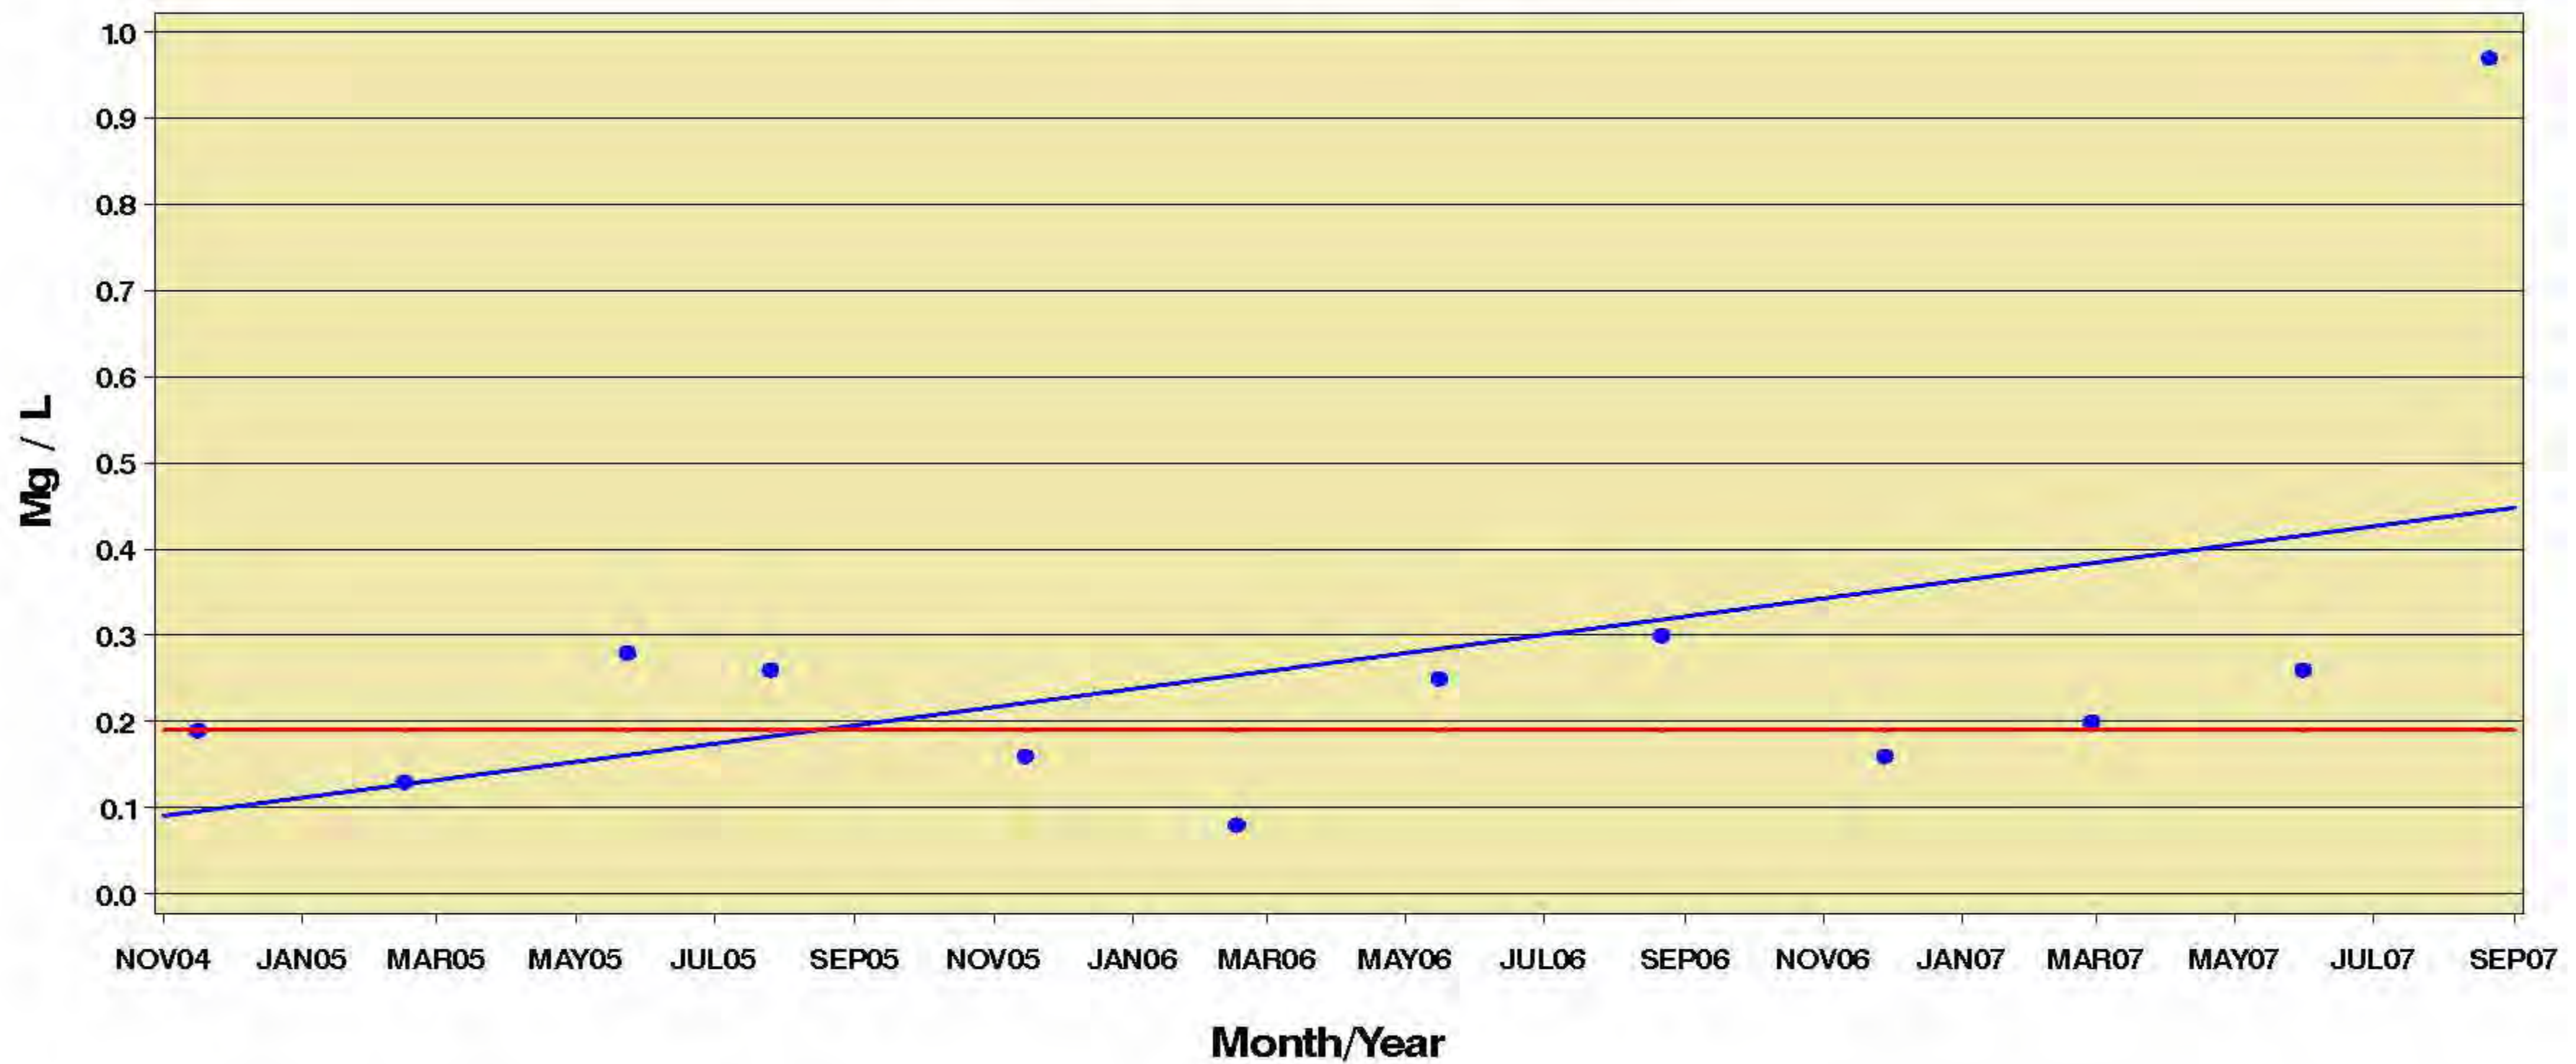

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.0963 R-Square= 0.2520 T-Value= 1.8350

Number of Samples= 12

Red line indicates the applicable 2010 Nutrient Screening Level