


Tabbs Bay

Station: 17926 Segment: 2426 Parameter: Salinity
Assessment Unit: 2426_01

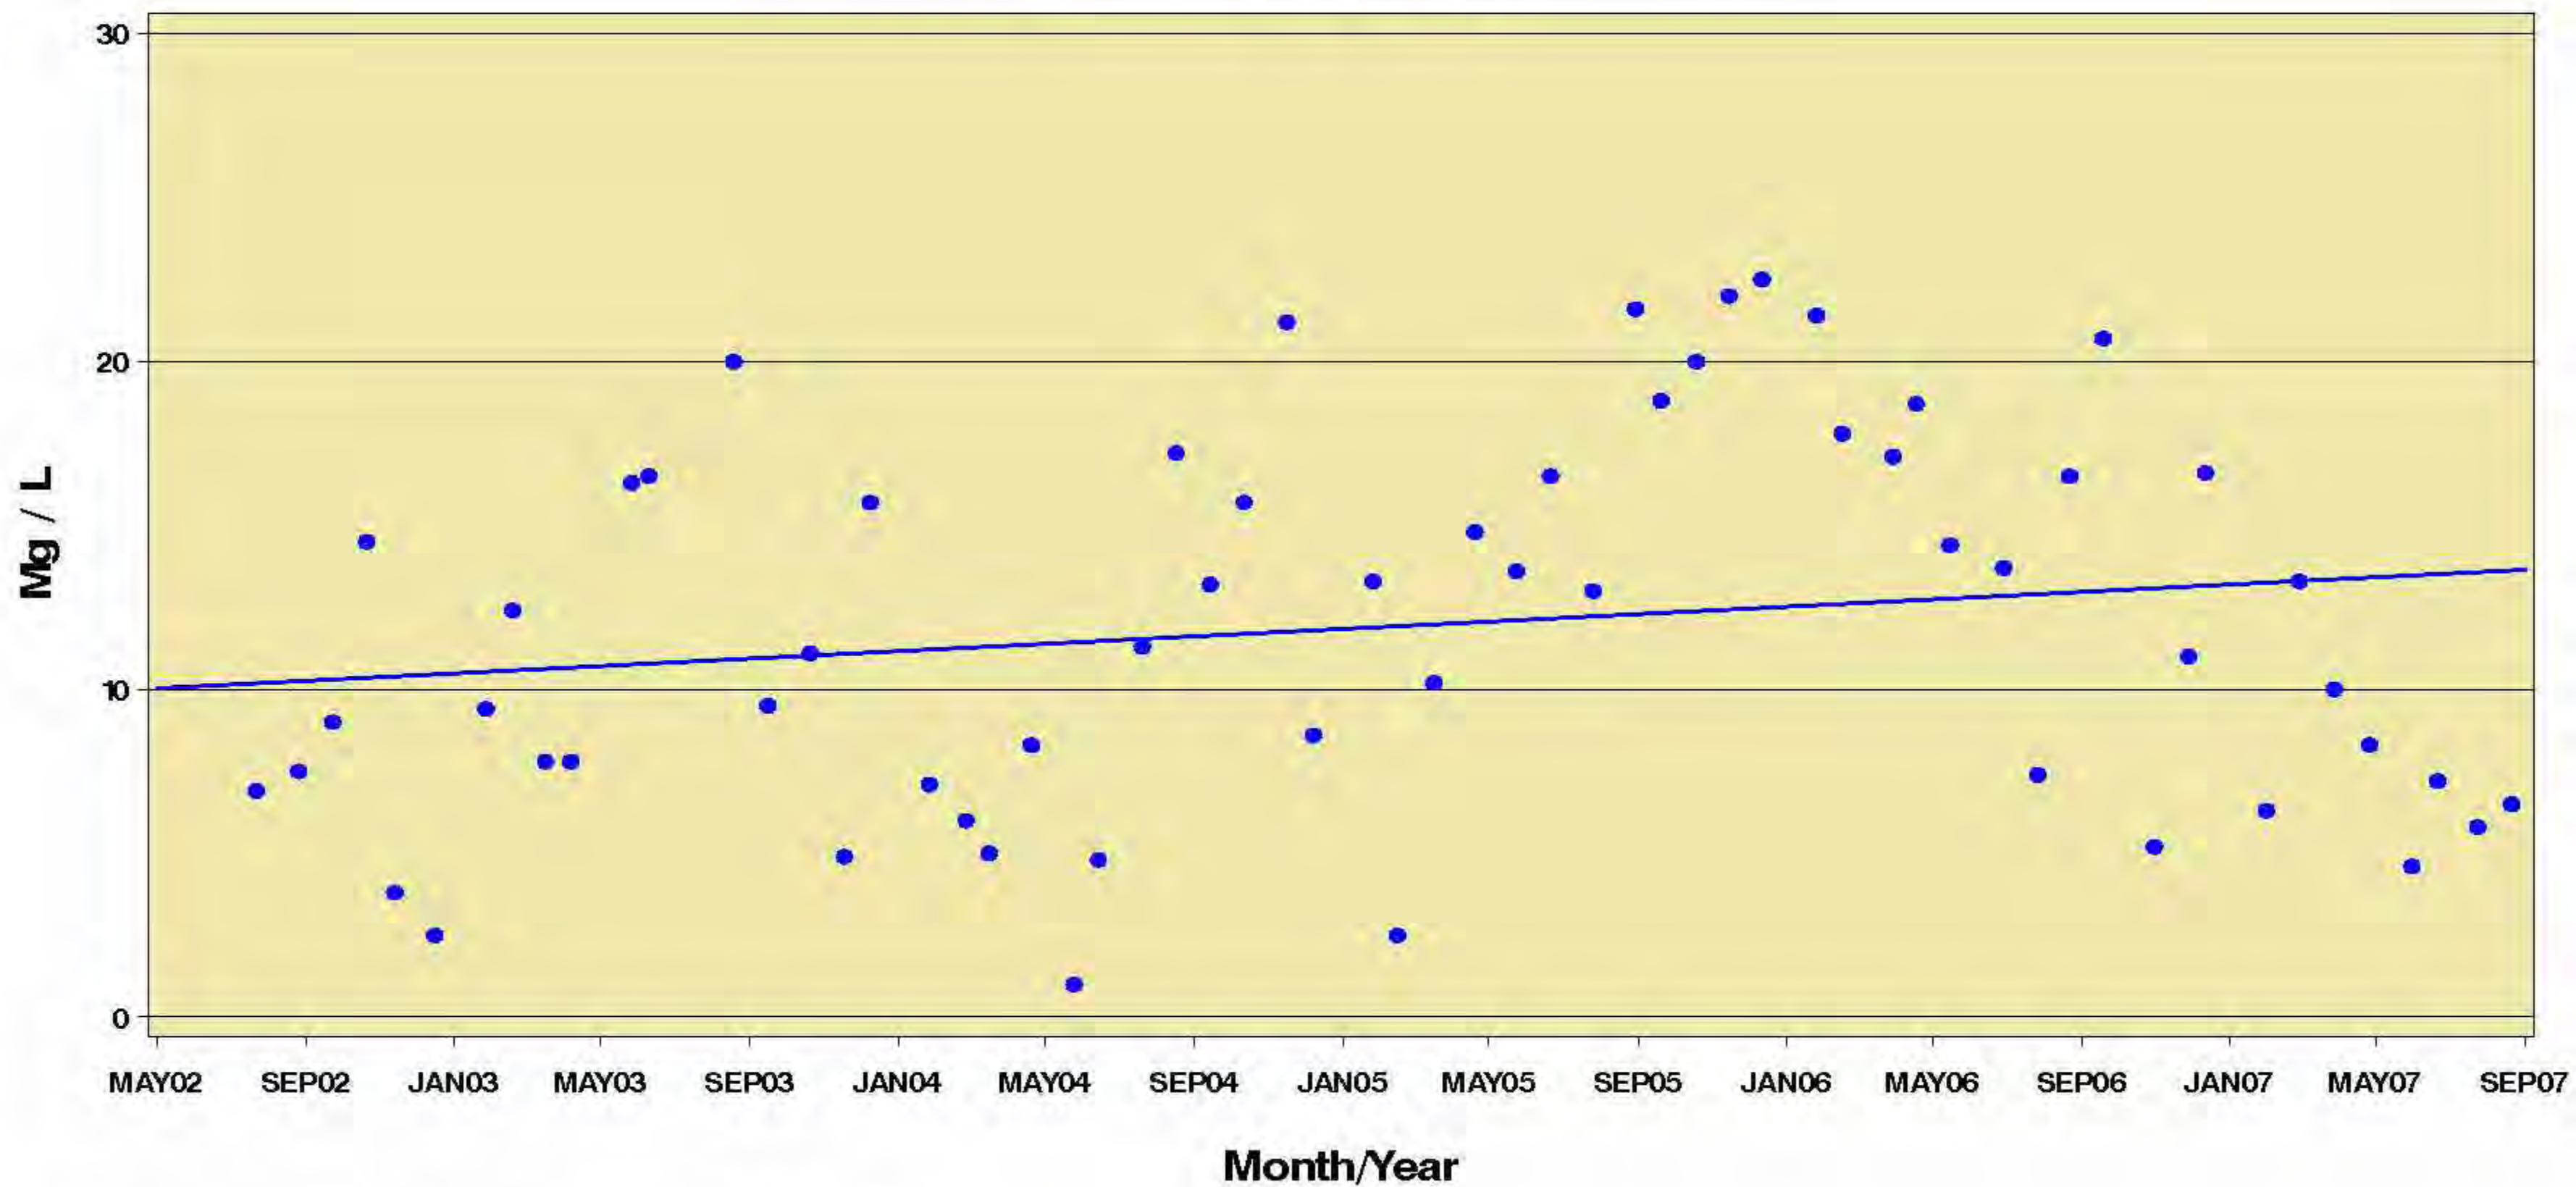

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.1688 R-Square= 0.0319 T-Value= 1.3930 Number of Samples= 61