


Tabbs Bay

Station: 17926

Segment: 2426

Parameter: Total Hardness

Assessment Unit: 2426_01

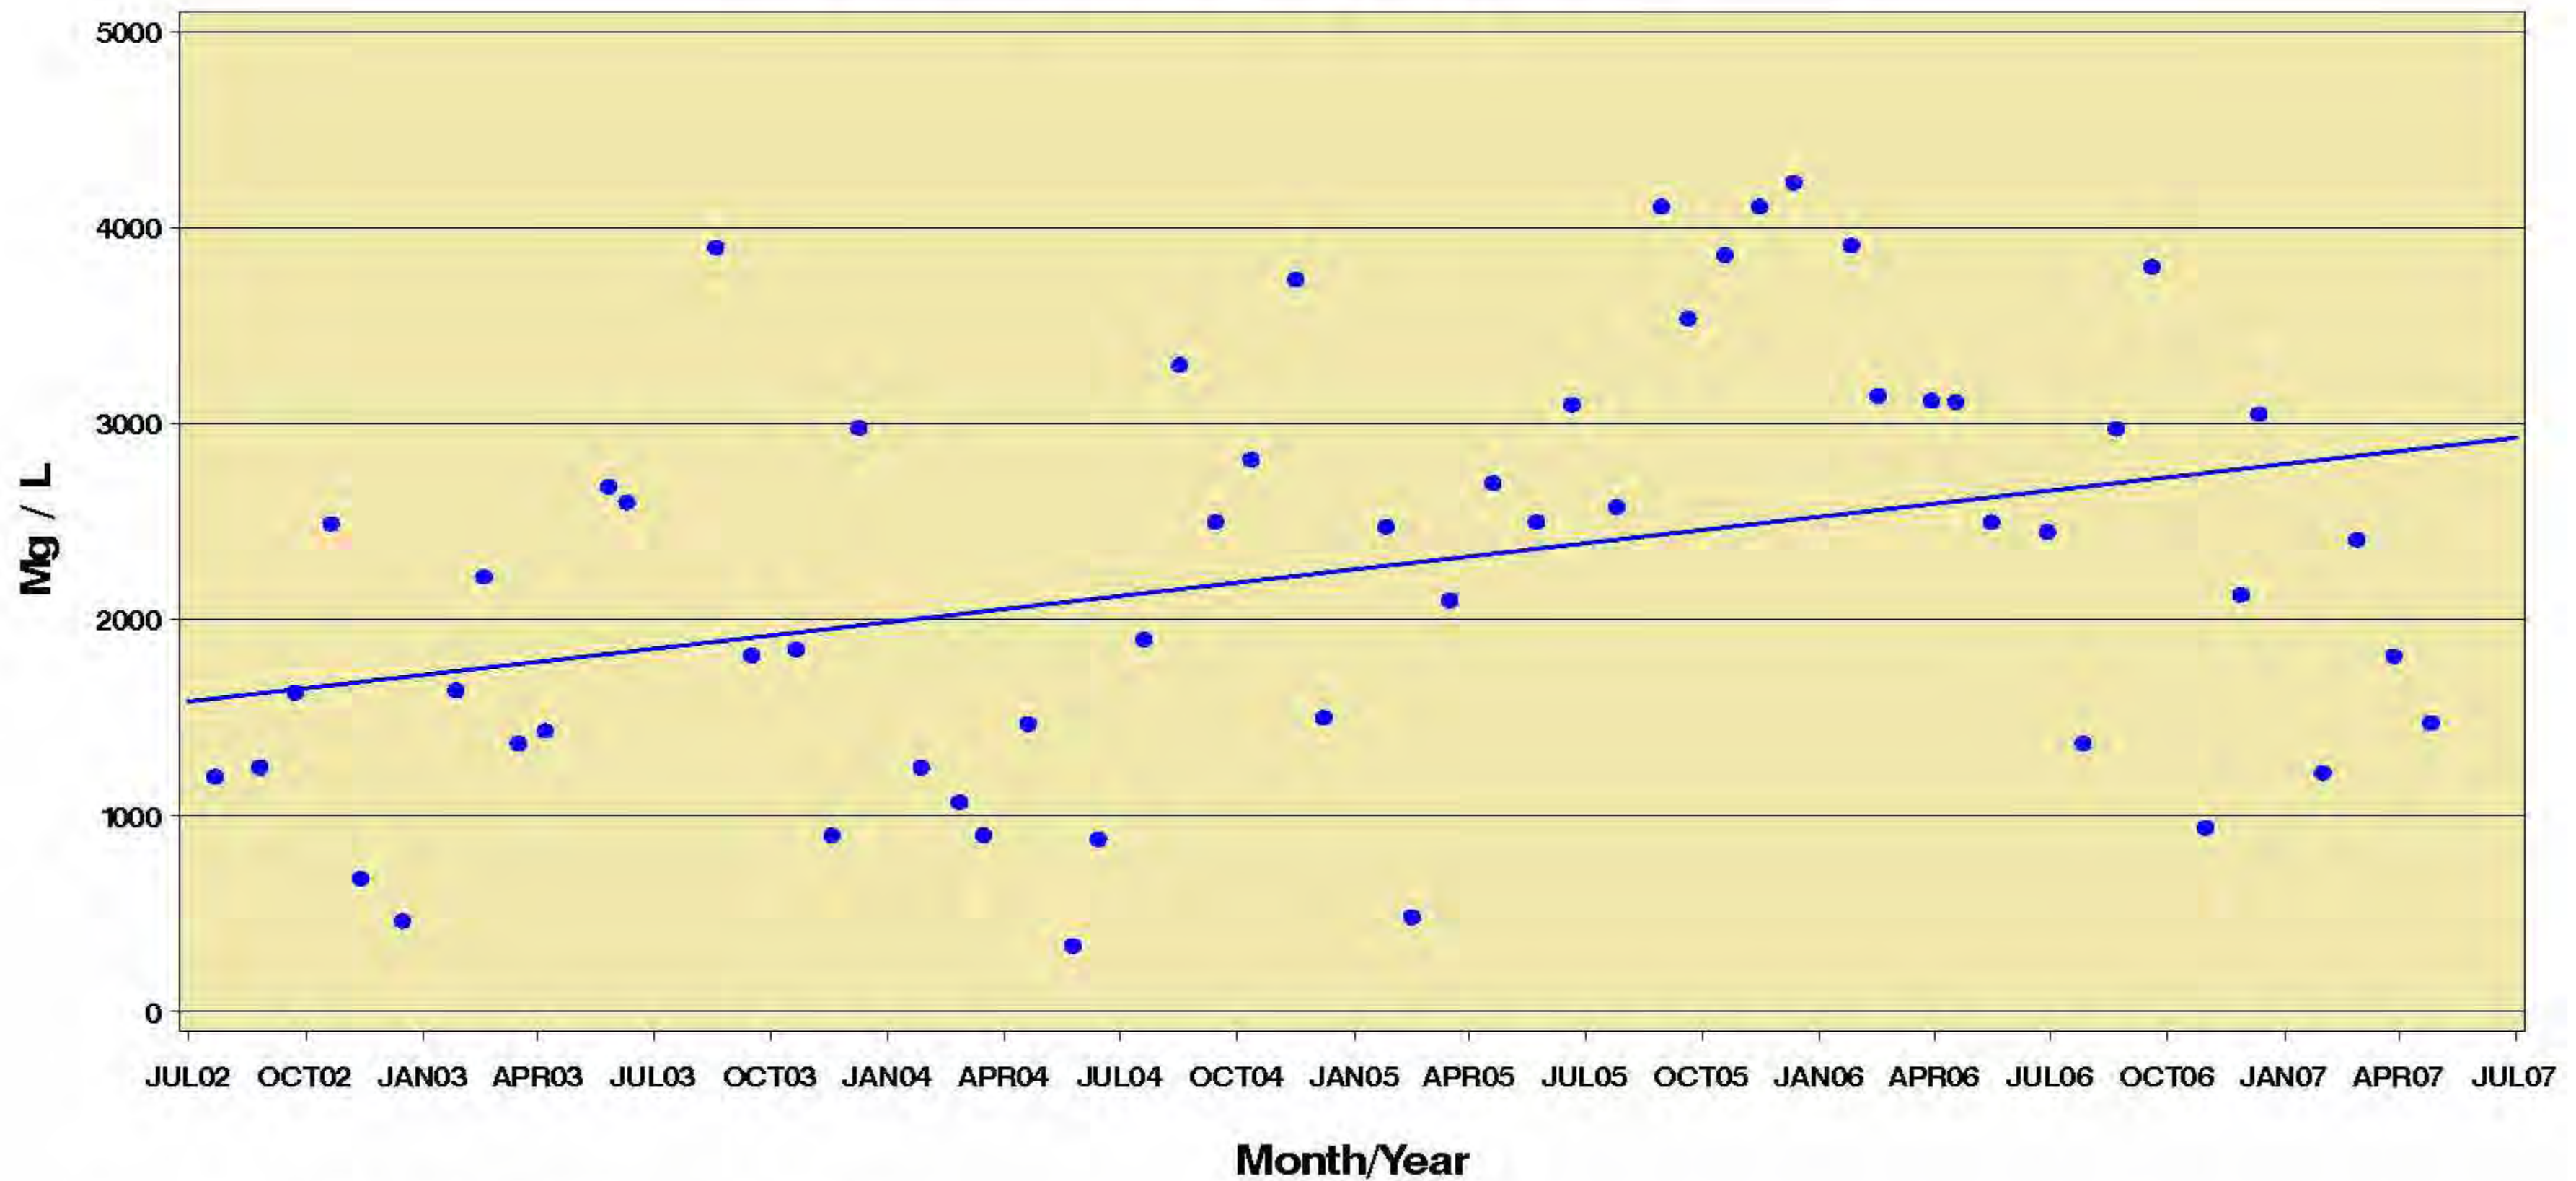

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.0061

R-Square= 0.1290

T-Value= 2.8550

Number of Samples= 57