

Tabbs Bay


Station: 17927

Segment: 2426

Parameter: Dissolved Oxygen

Assessment Unit: 2426C_01

2010 Water Quality Standard: 3.0 Mg / L

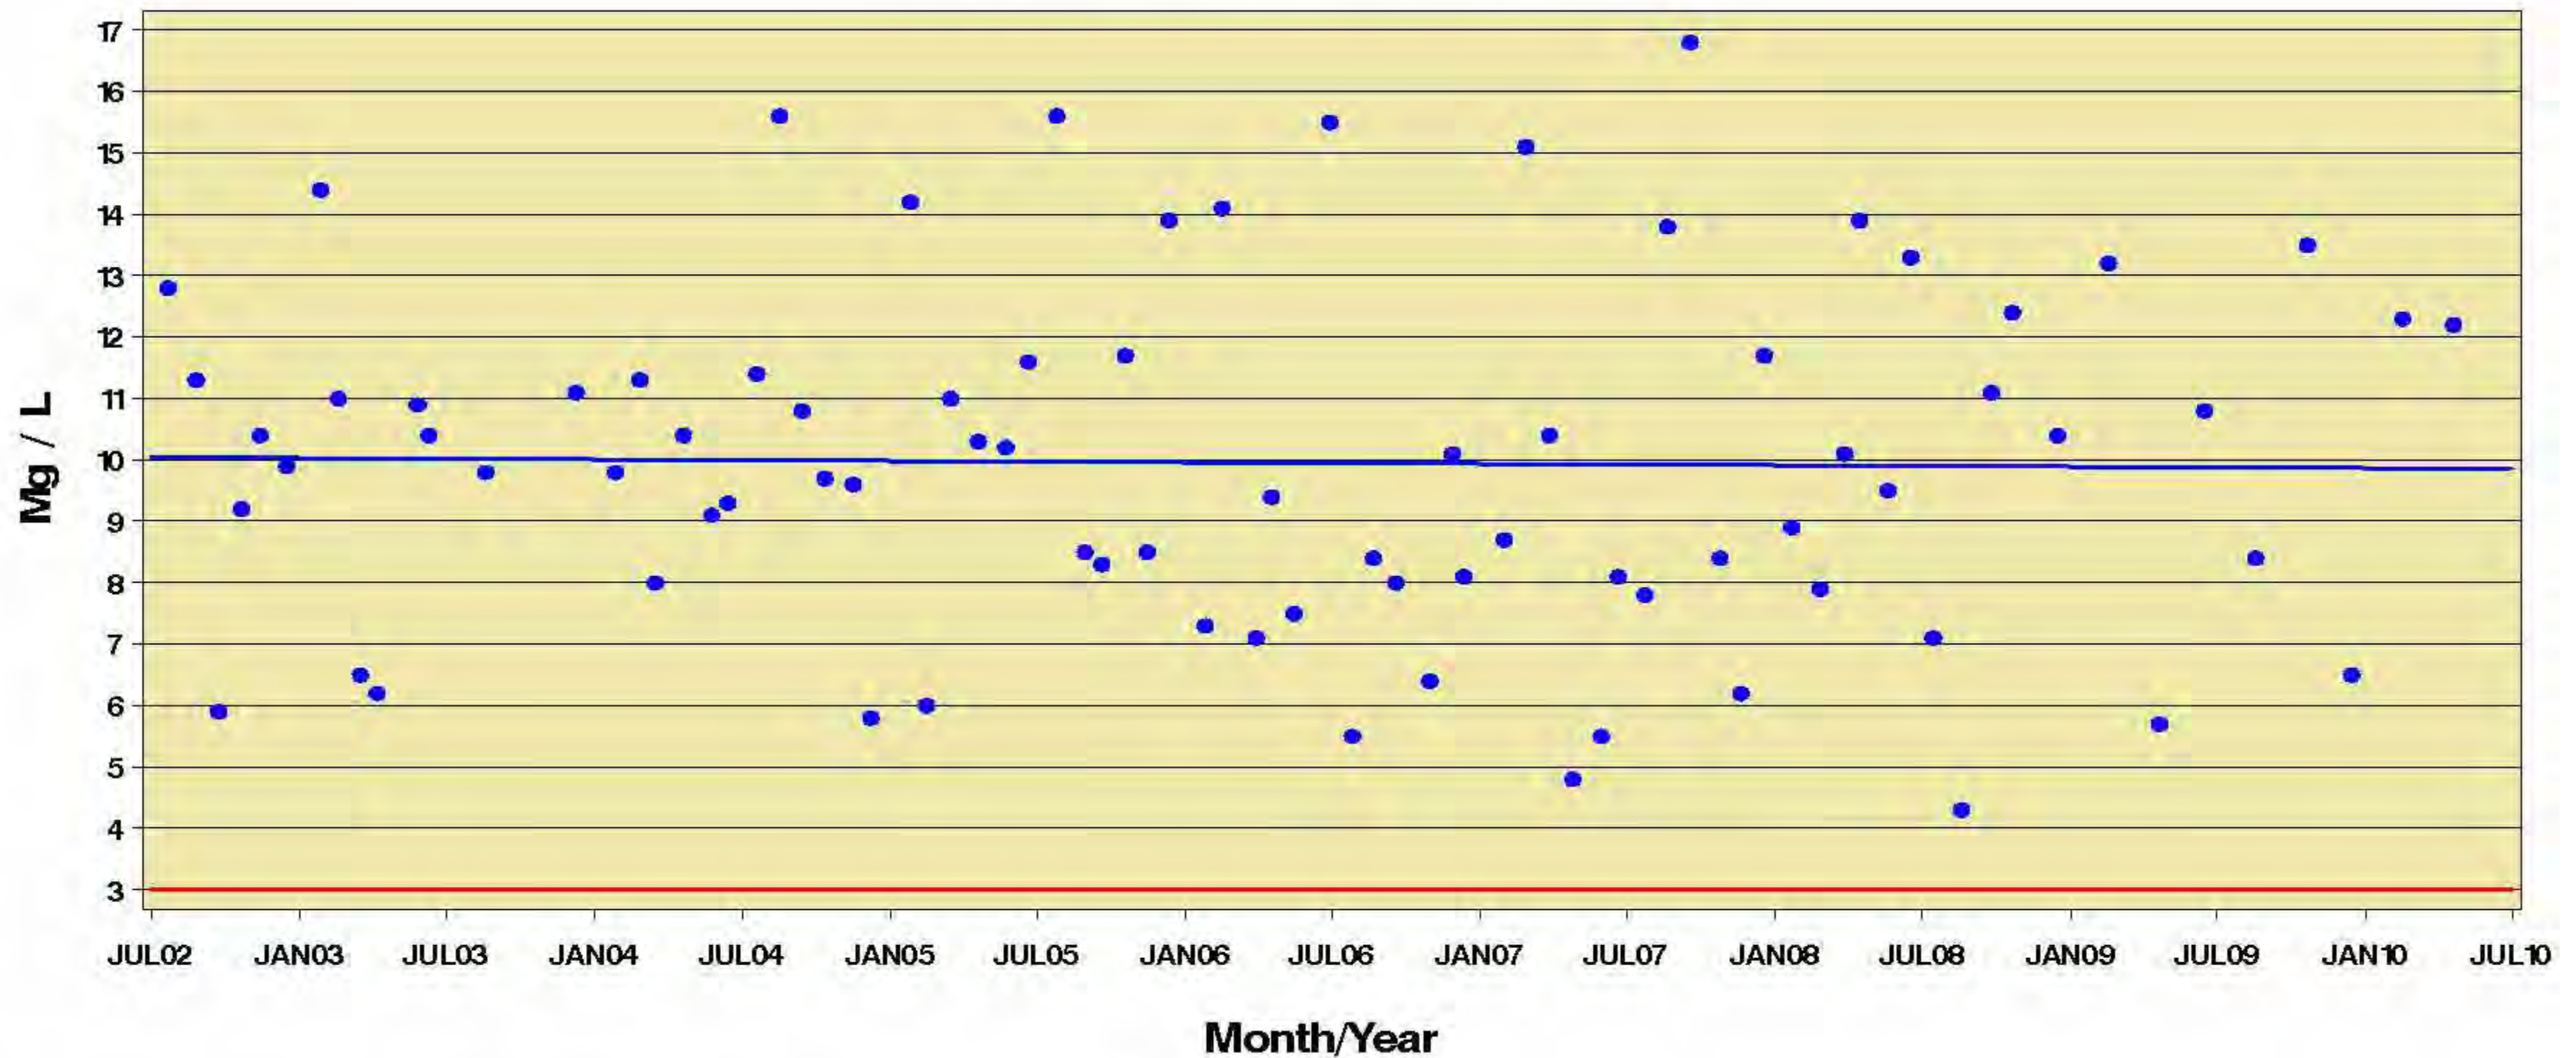

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.8844

R-Square= 0.0003

T-Value= -0.1460

Number of Samples= 81

Red line indicates the applicable 2010 Water Quality Standard