


Tabbs Bay

Station: 17927 Segment: 2426 Parameter: Nitrate-N

Assessment Unit: 2426C_01

2010 Nutrient Screening Level: 1.10 Mg / L

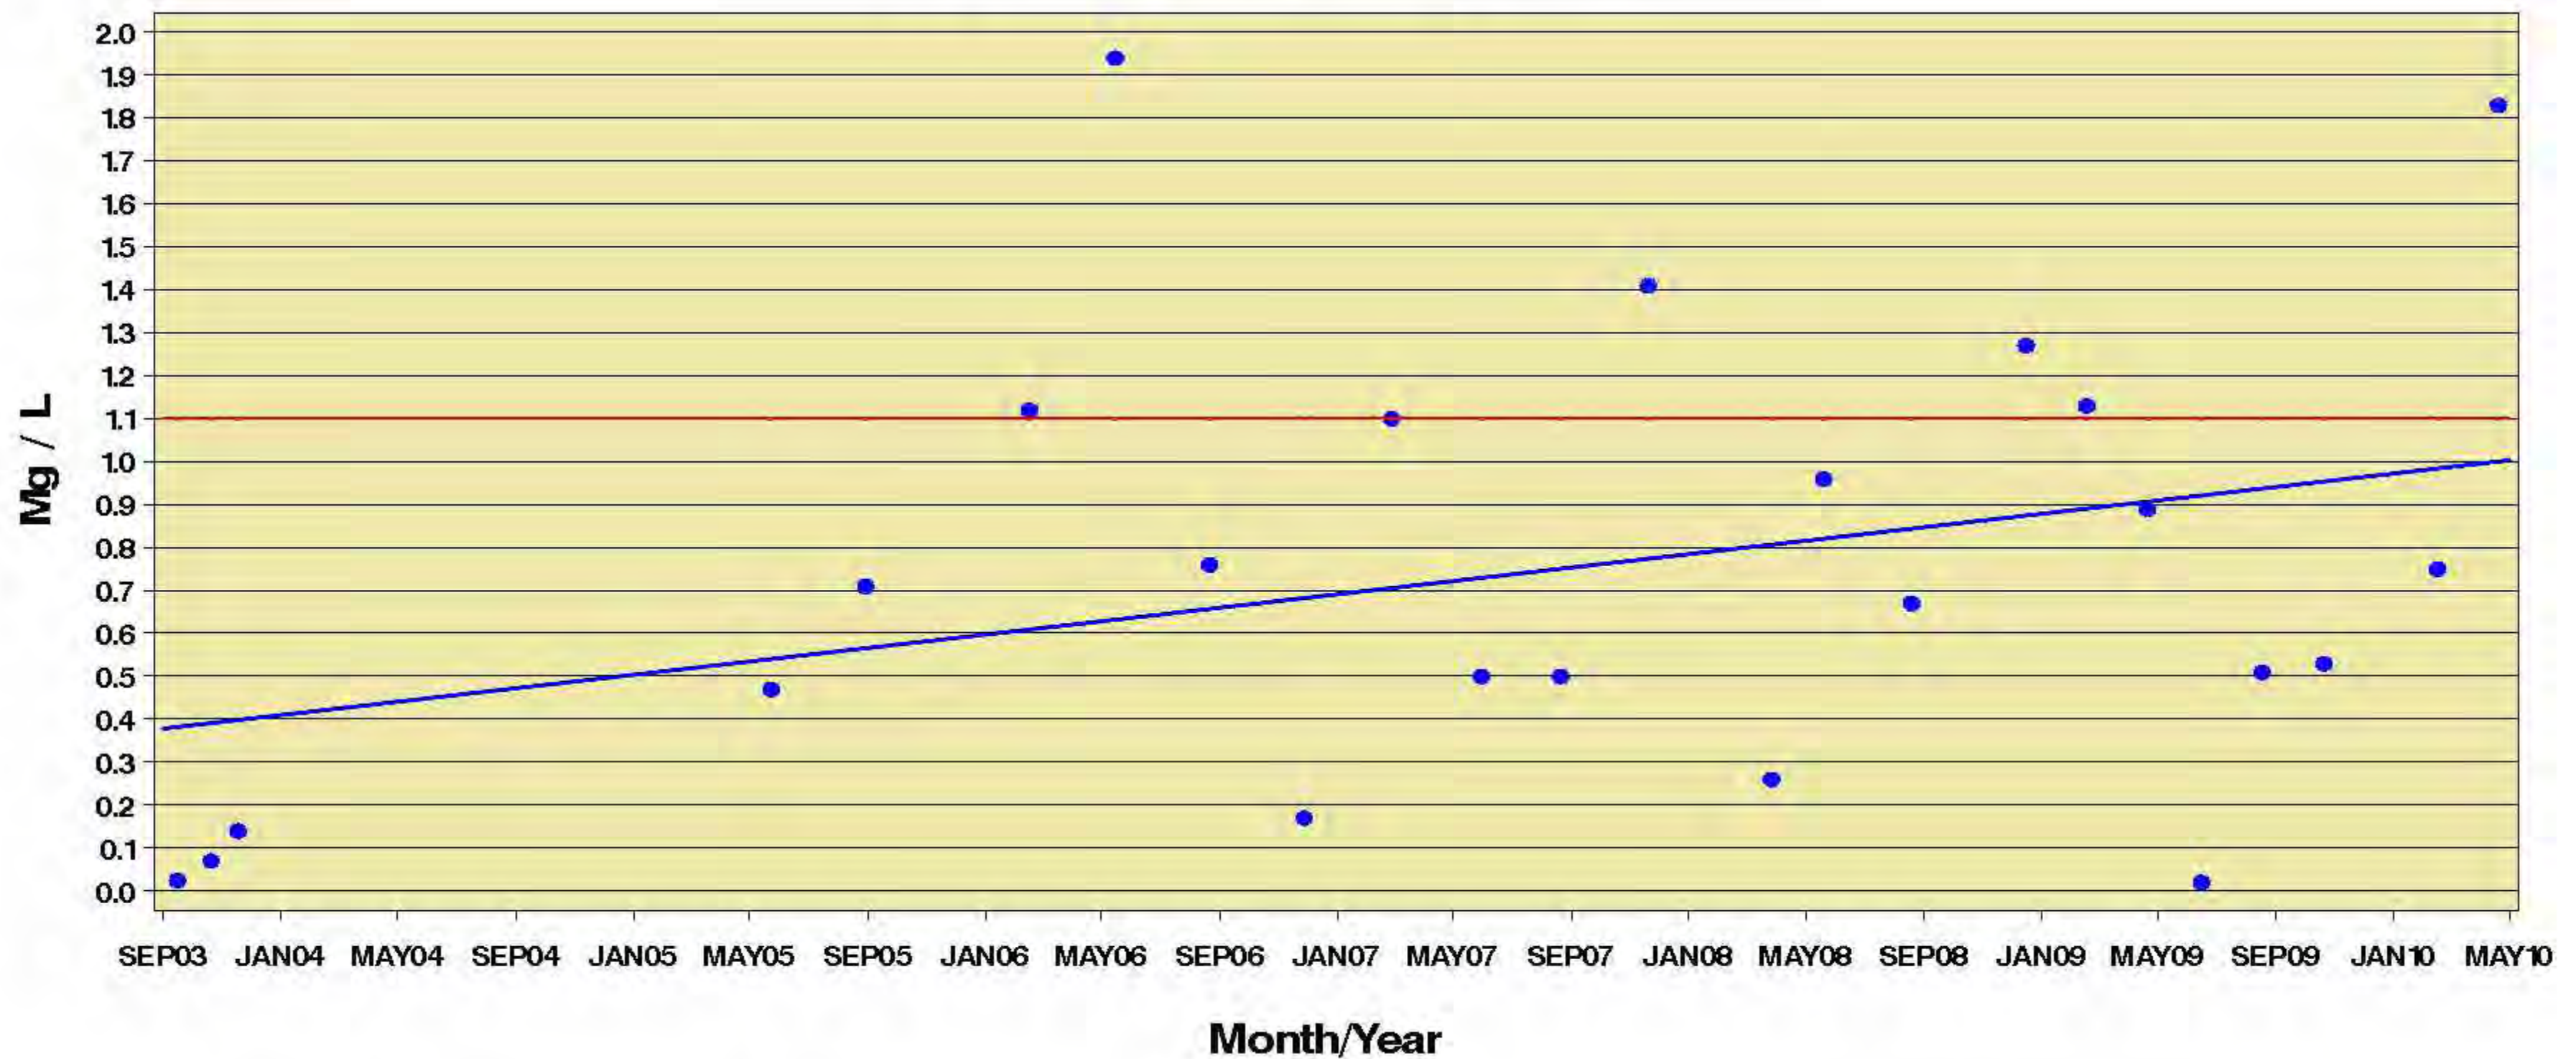

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.0905 R-Square= 0.1247 T-Value= 1.7710 Number of Samples= 24

Red line indicates the applicable 2010 Nutrient Screening Level