


Tabbs Bay

Station: 17927

Segment: 2426

Parameter: Specific Conductance

Assessment Unit: 2426C_01

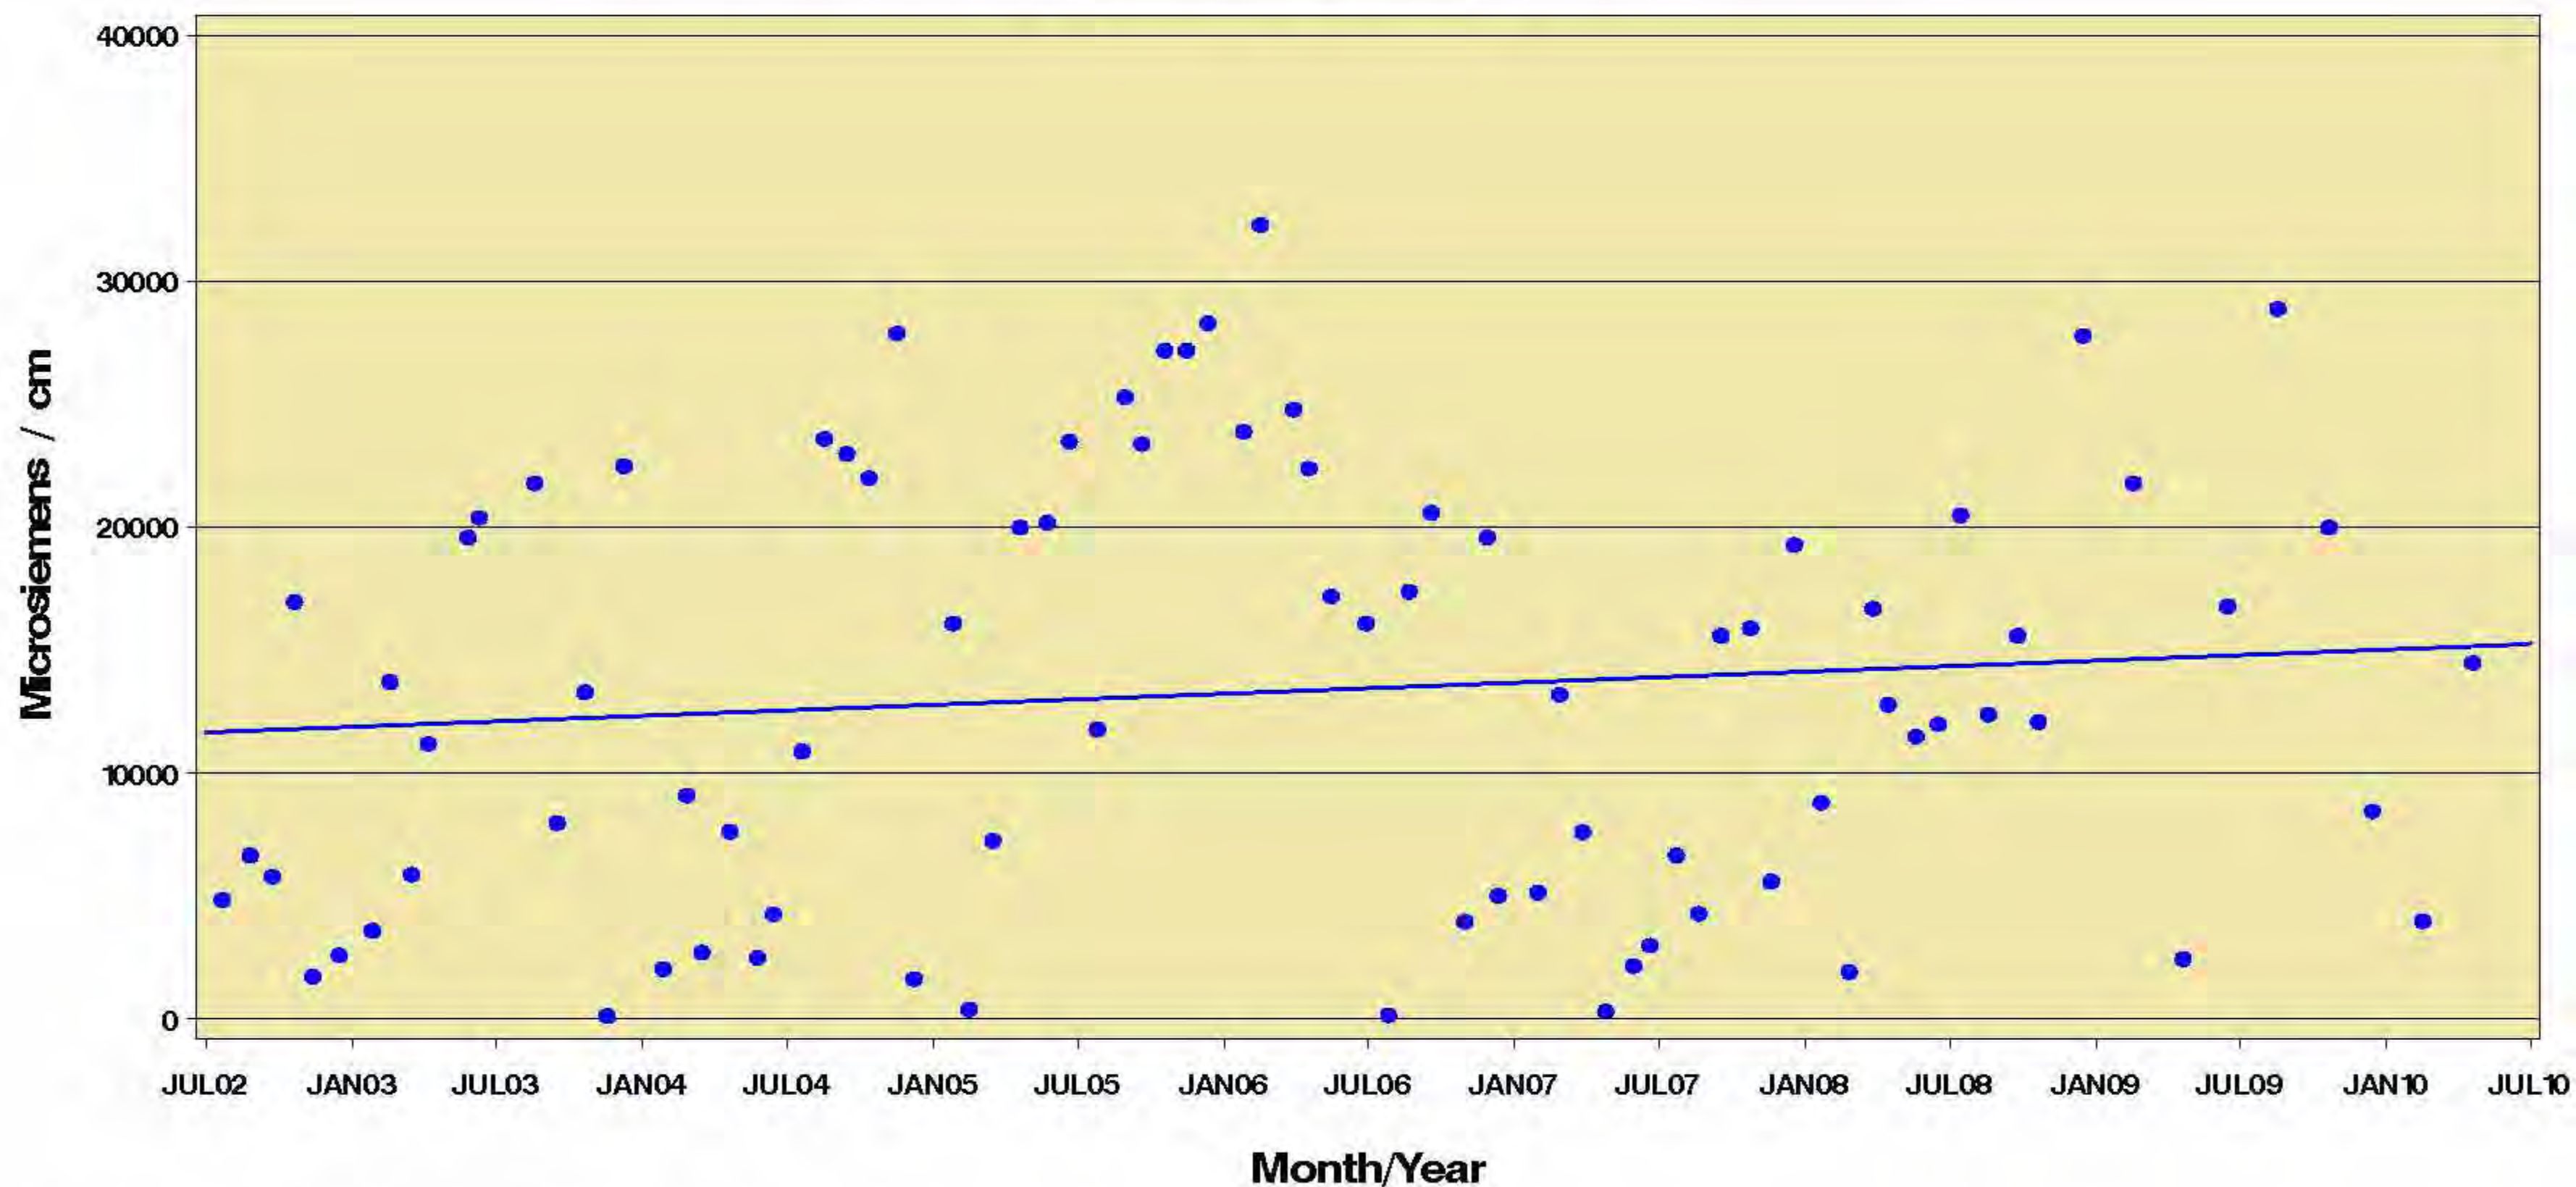

Trends are considered significant if the p-value is < 0.10

Regression p-value= 0.3172

R-Square= 0.0122

T-Value= 1.0060

Number of Samples= 84